

CEMINTEL[®]

BARESTONE

NEW ZEALAND DESIGN AND INSTALLATION GUIDE



STATE OF CLAD

Distributed exclusively in New Zealand by State of Clad

BARESTONE[™] EXTERNAL
External Installation

FCNZ604 July 2023

INTRODUCTION

TABLE OF CONTENTS

01 INTRODUCTION	2	Fire Performance	16
Introduction	2	Extreme Climate Conditions	17
02 PRODUCT OVERVIEW	3	Corrosivity Categories	17
Panel Information	4	Other Design Considerations	17
Product Specifications	4	05 COMPONENTS + ACCESSORIES	17
03 SYSTEM OVERVIEW	5	06 SYSTEM ENGINEERING	20
Pressure Equalised Ventilated Cavity System	6	Design, Detailing and Performance	
Sealant Filled Joints	7	Responsibilities	21
Applications	8	Barestone Residential Tables	23
Benefits of the Cemintel's Barestone External Panels on the Fixing System	8	Barestone Commercial Tables	25
System Solutions	8	NV9 Omega Rail Spacings	26
04 DESIGN + AESTHETIC CONSIDERATIONS	9	Panel Fixing Requirements	26
General	10	07 INSTALLATION	27
Panel Appearance & Finish	10	Prior to Installation	28
Panel Layout	11	Installation Set-Out	29
Structural	11	Installation for Timber and Steel Framing	29
Top Hats	13	08 CONSTRUCTION DETAILS	35
Pre-Drilling Panel Holes	13	09 SAFETY, HANDLING + GENERAL CARE	48
Face Fixings	13	Health, Safety and PPE	49
Window & Door Openings	14	Handling & General Care	49
Eaves Junction	14	10 WARRANTY, CLEANING + MAINTENANCE	50
Control Joints	14	Warranty	51
Moisture Management	15	Wash Down Process	51
Insulation and Energy Efficiency	16	Inspection, Repair and Maintenance	51
Solar Reflectance/Absorptance	16		

Introduction

Cemintel's Barestone walling system combines a prefinished surface with a simple installation system that can be used for residential and commercial buildings.

This Design and Installation Guide recommends good building practice and has been prepared as a general guide of design considerations, system engineering information and installation procedures for common external applications. It assumes that the user has an intermediate knowledge level of building design and construction. In no way does it replace the services of the building professionals required to design projects, nor is it an exhaustive guide of all possible scenarios.

It is the responsibility of the architect, designer and various engineering parties to ensure that the details in this Design and Installation Guide are appropriate for the intended application.

Barestone can be installed externally as a building facade or as an interior lining. This guide refers to **external installations** only as components differ depending on the installation.

Refer to the 'New Zealand Design and Installation Guide for Cemintel Barestone Internal Installation' for instructions regarding internal applications.




PRODUCT OVERVIEW

Panel Information

Barestone panels provide a natural, raw appearance that blends seamlessly with its environment and easily adapts to modern, contemporary building designs. Barestone is available in four colours – Original, Ash, Lunar and Graphite. As with natural timber or stone, every piece is unique in colour and patterning, reflecting the qualities of the natural ingredients used in the manufacturing process.

The panels are prefinished, square edged, compressed fibre cement (CFC), consisting primarily of Portland Cement, cellulose fibre, air, and water. They feature Cemirseal water-blocking technology and are factory sanded, ready for installation with the NV9 Omega system.


Cemintel Barestone panels are compressed to produce a dense 9mm panel that offers superior performance in terms of strength and durability, making Barestone External an excellent choice for commercial applications subject to higher wind loads.

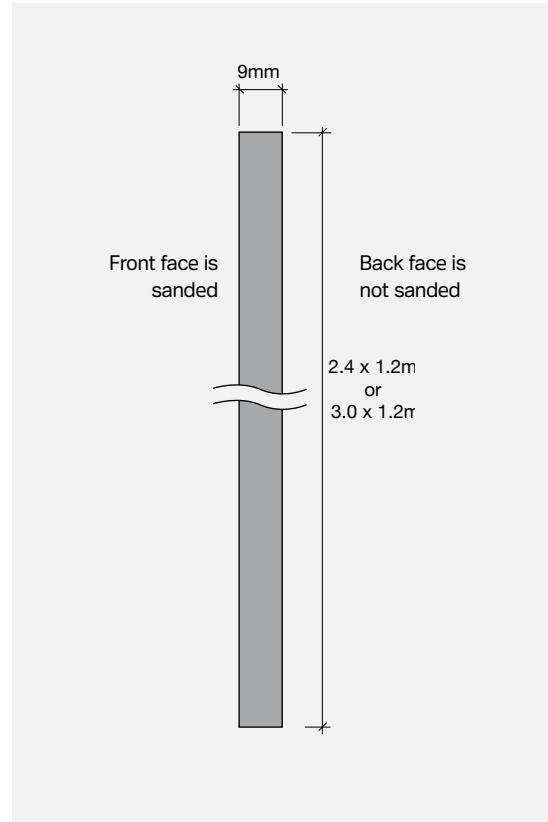

Product Specifications

Property	Specification	Manufacturing Tolerance	Relevant Standard
Panel Width	1200mm	+ 0 / - 2.0mm	AS 2908.2
Panel Length	2400 and 3000mm	+ 0 / - 2.0mm	AS 2908.2
Panel Thickness	9mm	+ 0.45 / - 0mm	AS 2908.2
Panel Weight (EMC)	17.8kg/m ²		AS 2908.2

Thickness (mm)	Width (mm)	Length (mm)	Mass (Nominal)	Panels per pallet
9	1200	3000	17.8kg/m ²	20

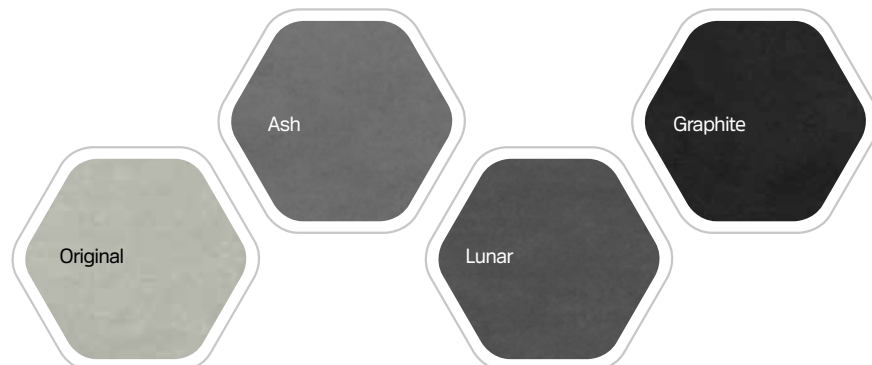

A large, stylized graphic of the numbers '03' in a light beige color, serving as a background for the title. The '0' is a simple oval, and the '3' has a curved top and a vertical stem.

SYSTEM OVERVIEW


Pressure Equalised Ventilated Cavity System

Cemintel Barestone panels can be installed horizontally or vertically onto steel or timber stud framing or masonry/concrete using the proven and versatile NV9 Omega top hat fixing system. The NV9 Omega system provides a versatile and durable façade which is suitable for an extensive range of building types. Panels are pre-drilled and then fixed with expressed joints to vertical metal top hats using Barestone rivets. A vertical gasket tape is placed on the top hat to provide added

weather resistance, and a backing strip is used at horizontal joints to reduce water ingress.

Panels are installed as a pressure equalised ventilated cavity system which is easy to install and delivers a high weather performance system. In certain conditions, eg. higher corrosive zones, there is the option of sealing joints and header to reduce the circulation of air behind the façade.


Pressure Equalised Ventilated Cavity System

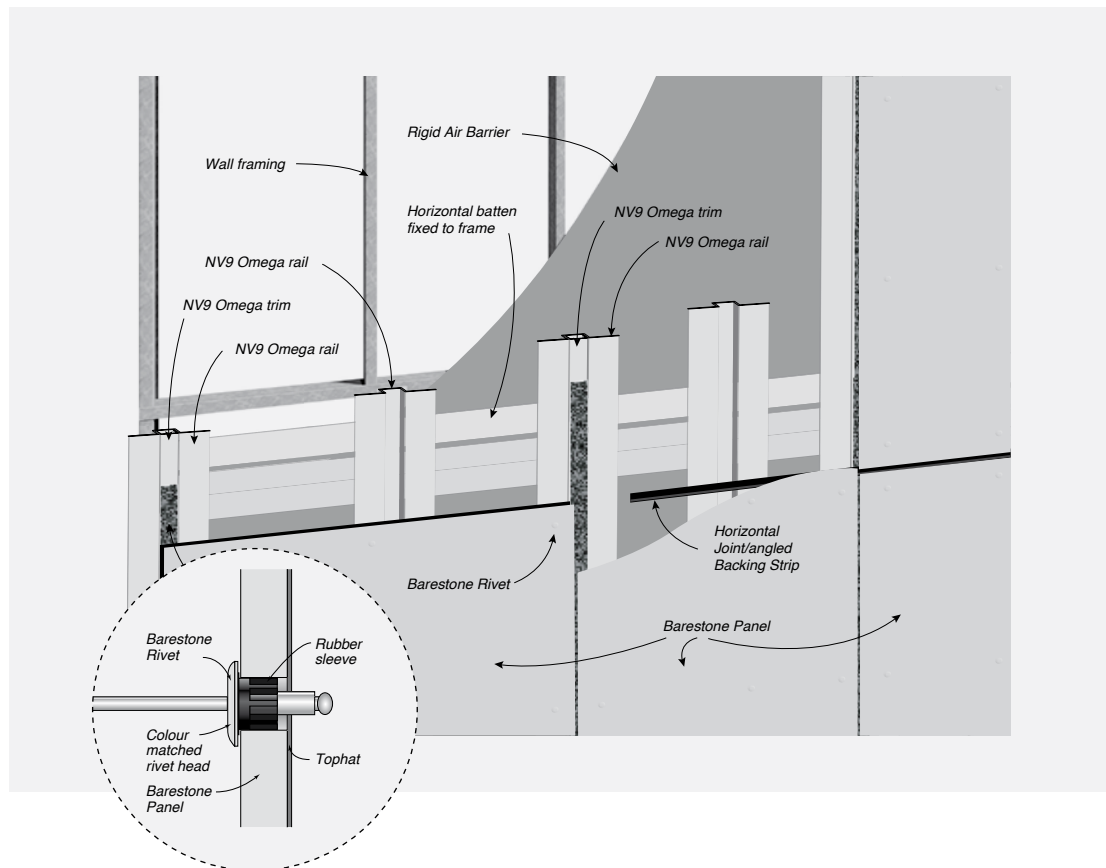

SYSTEM OVERVIEW



Typical Barestone System Cross Section
for Steel Framing

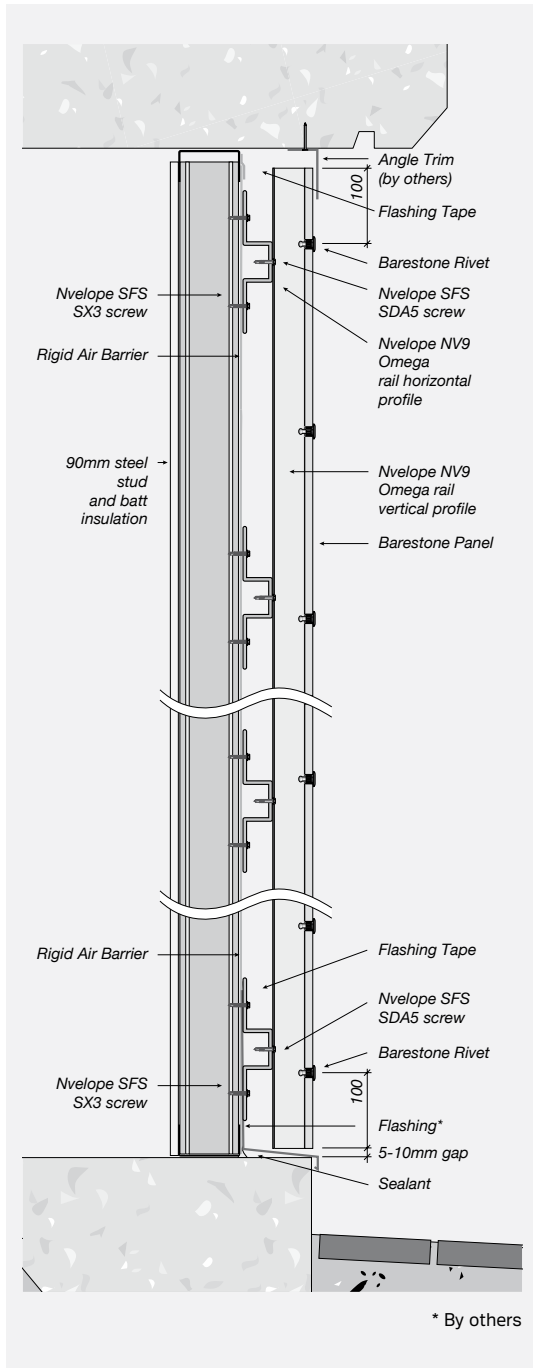

In a pressure equalised system, a cavity is formed between an air barrier and the façade. Openings around the base and top of the façade allow pressure equalisation, and create the drying benefits of air circulation and drainage. This system reduces the risk of moisture penetration and prevents moisture build up, allowing the building shell to dry out, creating a healthier, more breathable building.

Panels are installed to give an express jointed appearance. A vertical gasket tape is placed on the vertical top hat and a metal backing strip is placed at horizontal joints. Horizontal joints at base of wall and at inter-storey junctions are left open to maintain a ventilated cavity and to allow for moisture drainage.

Rigid air barriers are recommended for extra high wind zones or wind loads over 1.5kPa ULS. All air barriers must be installed as per manufacturers instructions.

Masonry and concrete substrates must be sealed to act as an air barrier for an effective waterproofing system.

Sealant Filled Joints

In some applications, or for aesthetic purposes, it may be preferable to install Barestone External panels with joints that are sealant filled. In this case, horizontal backing strips are used and joints are sealed to minimise moisture getting into the cavity.

Cemintel Barestone panels are to be drilled at fastener locations and then fixed onto supporting metal top hats using Barestone rivets.

03

SYSTEM OVERVIEW



Applications

Cemintel Barestone is suitable for all building classes where metal top hats can be fixed to framing however, site environmental factors such as wind and corrosivity zones must be taken into account to determine its suitability for a particular application.

The panels and system have been designed to withstand ultimate wind pressures up to 7.0 kPa including cyclonic conditions.

Benefits of Cemintel's Barestone External Panels on the Fixing System



- Low maintenance
- No requirement for additional painting costs
- Potential to speed up the construction process
- Large format, lightweight panels are designed to be fixed to top hats which can be fixed to industry standard steel, timber or masonry structural frames
- Cemintel's express jointed fixing system is widely recognised for its high performance
- Cemintel's pressure equalised ventilated cavity system allows for higher wind loads, minimises water ingress and allows air flow and drainage
- Choice of fasteners (either exposed head screw or Barestone rivet) allows different aesthetic options
- Suitable for Sea Spray Zones B, C & D
- The unique Barestone rivet with pre-assembled rubber sleeve allows slight movement across the panel thereby reducing the stresses created where panels are installed with "fixed" points
- Panels are easy to cut for openings eg. around windows and power boxes
- Durable and weather resistant
 - Provides effective protection against wind, rain and temperature extremes, mould and mildew
 - Panels will not rot, swell or warp when correctly installed and maintained
- Fire - Type A Classification tested in accordance with Appendix C 7.1 of C/AS2. (Table C1.3 of C/AS2)

System Solutions

A technical Data Sheet can be downloaded from stateofclad.co.nz

Weatherproofing	Suitable for a serviceability wind pressure of +2.50 kPa when installed as a pressure equalised system.	AS/NZS 4284
Wind actions	Suitable for ultimate wind loads up to 7.0 kPa with Rigid Air Barrier.	AS/NZS 4284 & AS 4040.3



DESIGN + AESTHETIC
CONSIDERATIONS

04

DESIGN + AESTHETIC CONSIDERATIONS

This section outlines some important areas for consideration in determining whether Cemintel Barestone External is suitable for the required application. The following points are not exhaustive. It is the responsibility of the Architect / Building Designer to ensure the design conforms to NZBC requirements and other relevant building standards that may exist for that location. This guide should be read in conjunction with the NZBC.

Panels, top hats and structural framing are required to resist wind loads that are specific to the building site. Additional “local pressure factors” apply to the panels and top hats in accordance with the wind code AS/NZS 1170.2.

Once wind loads have been determined top hat spans, fastener spacings, and sheet fixing details can be selected from the appropriate tables in the ‘System Engineering’ Section of this guide. It is also the responsibility of the Architect/Building Designer to select the appropriate corrosivity category.

Panel Appearance and Finish

As with natural timber and stone, every Barestone panel is unique in colour, patterning and texture. The combination of natural ingredients and the manufacturing process will result in variation whereby some panels may have larger areas of lighter or darker colouring. There may also be white or black mineral deposits appearing through the panel which come from the raw materials and the manufacturing process. This randomness and uniqueness is what gives Barestone its character and is not a fault.

Note that product may vary from sample materials provided and the architect/builder/installer/owner should ensure that variation in look between panels is acceptable and meets aesthetic requirements prior to installation.

Being prefinished, special care needs to be taken prior to and during installation to protect panels and prevent staining and scratching.

DESIGN + AESTHETIC CONSIDERATIONS



Panel Layout

Panel layout should take into account the following:

- Aesthetic design
- Top hat spacing to allow for expressed joint widths (Refer Fig. 4.01)
- 8-10mm recommended joint width
- Type of structural support
- Size and location of openings
- Building size
- Location of building control joints

Panel layout can be in a grid pattern where vertical and horizontal joints are continuous (Refer Fig. 4.02 & 4.03). In these layouts, construction joints may be positioned behind any vertical or horizontal sheet joint (refer to “Construction Drawings & Details” section).

Panel layout can also be in a vertical or horizontal half-bond pattern where some joints are discontinuous (Refer Fig. 4.04 & 4.05).

This is not an exhaustive list of panel layouts.

FIGURE 4.04 Horizontal Sheeting Half-bond Pattern

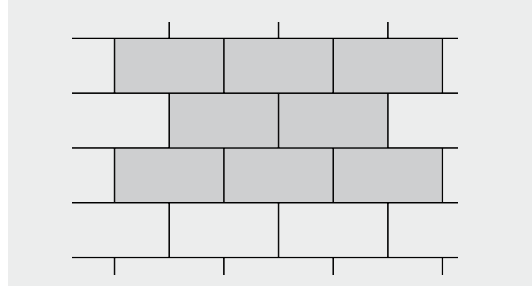


FIGURE 4.05 Vertical Sheeting Half-bond Pattern

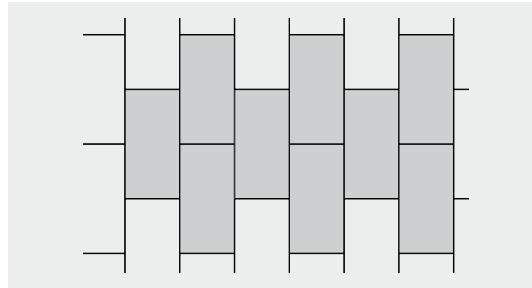


FIGURE 4.01 Typical Top Hat set-out - 1200mm Width Vertical Panels with 10mm Joints shown

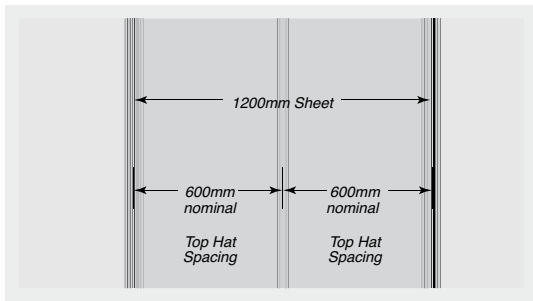


FIGURE 4.06 Skirt Panel (Floor to Floor in Excess of 3m)

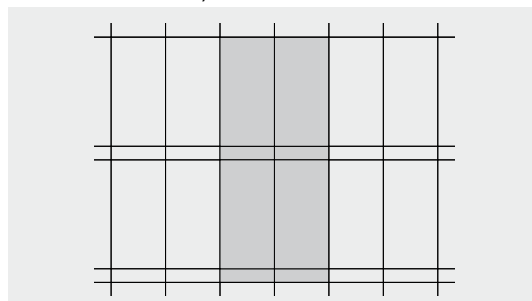


FIGURE 4.02 Horizontal Sheeting Aligned Grid Pattern


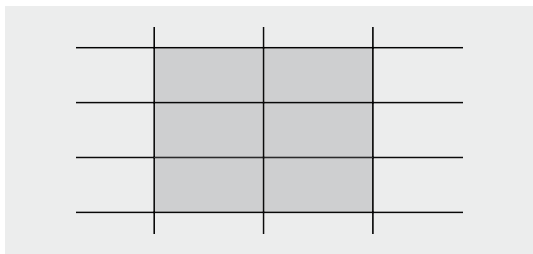


FIGURE 4.03 Vertical Sheeting Aligned Grid Pattern

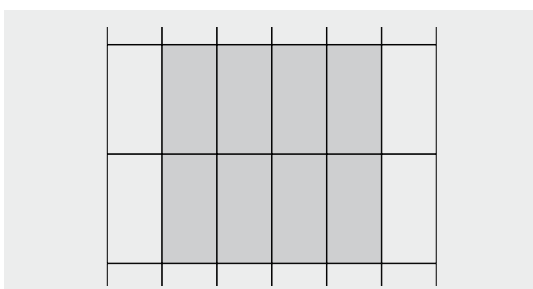

Structural

Framing and Substrate Options

Barestone External panels and ExpressWall system can be fixed to either timber or steel framing, as well as to masonry and concrete substrates.

For timber and steel framing, the minimum requirement shall be in accordance with the following standards:

- NZS 3604 – Timber Framed Buildings.
- AS/NZS 4600 – Cold-Formed Steel Structures.
- NZS 3404 – Steel Structures.


04

DESIGN + AESTHETIC CONSIDERATIONS

Timber Stud or Steel Framing

All vertical top hats must be installed onto horizontal top hats and supported by a primary structural system (ie timber or steel stud framing – Refer Fig. 4.07).

FIGURE 4.07 Fixing to Timber or Steel Stud Framing

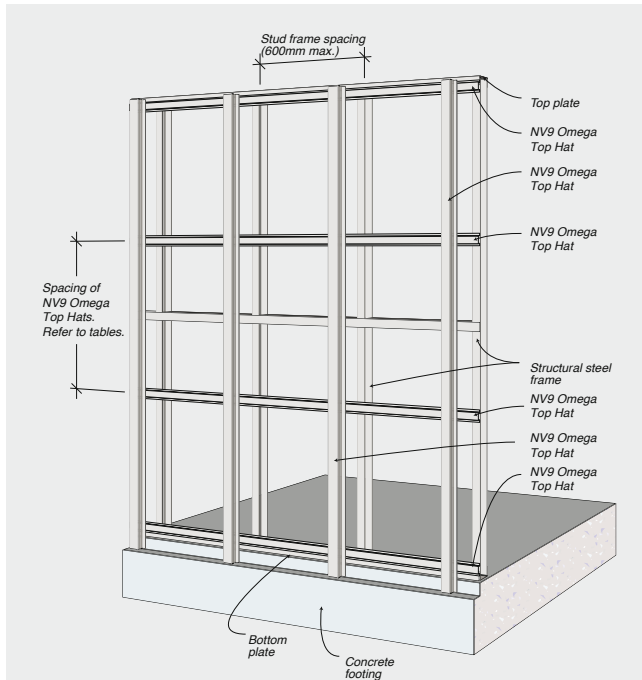

The connection of Top Hats to the structural frame requires engineering design. **It is the responsibility of the project engineer to specify the connection of the top hats to the support structure.**

Masonry or Concrete Walls

ExpressWall framing can also be fixed over masonry or concrete walls (Refer Fig. 4.08). **All top hat connections must be designed by the project engineer.**

Wind Pressures

Barestone External installation has been evaluated for use in all New Zealand wind zones up to and including Extra High in accordance with NZS 3604 for wind pressures up to 7.0 kPa under AS/NZS 1170.2, (including cyclonic zones when fixed to steel framing). In highly corrosive environments, appropriate measures should be taken to protect the frame and metal components from corrosion. Refer to Corrosive Zones table in 'System Engineering' section.


It is critical that the frame is true and plumb. Industry best practice for framed tolerance allows up to 5mm misalignment over a 3m distance. When retrofitting Barestone External to existing walls, the suitability of the substrate must be assessed.

AS/NZS 1170.0 Table C1 suggests that support framing be designed for a maximum deflection of span/250. Span tables are located in 'System Engineering' section..


DESIGN + AESTHETIC CONSIDERATIONS



FIGURE 4.08 Fixing to Masonry Wall

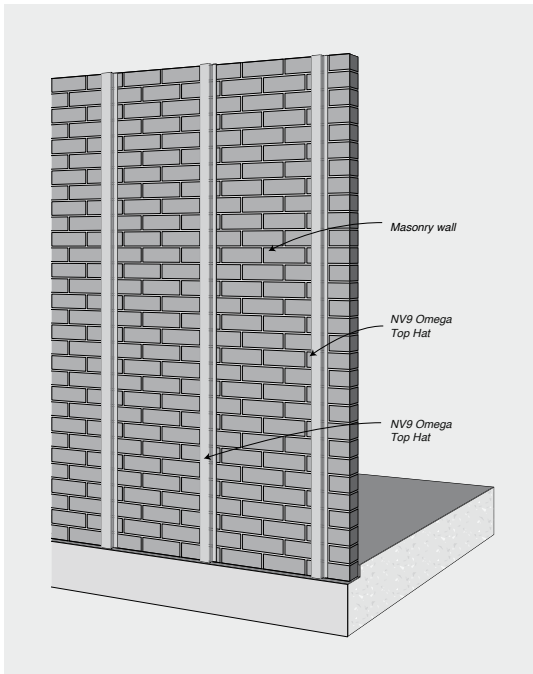

The **NZ9 Omega Centre Trim** is used to support the panels at vertical joints. The NZ9 Omega Centre Trim is manufactured from aluminium.




Pre-Drilling Panel Holes

Holes for rivets must be pre-drilled. This activity can be done off-site prior to installation. For **Barestone rivets**, a 9.5mm carbide tipped drill bit with centering tip must be used to accommodate the Barestone rivet. Do not use hammer action when drilling.

Clean dust out of holes.

Top Hats

The **NV9 Omega top hat** is a purpose designed aluminium section for supporting panels. The unique profile acts to accommodate movement of the sheets at the vertical joints. It is designed to be used in conjunction with NV9 Omega Centre Trim and gasket tape at panel joints. The NV9 Omega top hat is manufactured from 2.4mm aluminium.

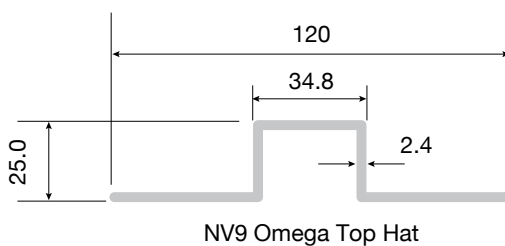

Face Fixings

Panels are fixed to top hats using Barestone Rivets. Specific Milwaukee and Gesipa Accubird rivet gun accessories must be used to ensure correct fixing of the Barestone Rivet. Rivets are manufactured from stainless steel consisting of V4A stainless steel (equivalent to 316 grade) mandrels and V2A stainless steel (equivalent to 304 grade) sleeves.

Barestone rivets are available in colour matching finish or plain Stainless Steel rivets.

The Barestone rivet, with its unique rubber sleeve, allows a very slight movement across the whole panel thereby reducing the stresses created where panels are installed with "fixed" points. Note: Use of standard rivets and gun heads is NOT ACCEPTABLE.



DESIGN + AESTHETIC CONSIDERATIONS

Window & Door Openings

Cemintel Barestone is compatible with industry standard aluminium windows. Aluminium windows **MUST NOT** have sill drain holes that can direct water into the wall cavity.

With the cavity created by the top hat system, particular attention needs to be given to the set out of windows and doors.

The depth of the window needs to be taken into account in the design of the building frame so that the front face of the panel is properly aligned with the window and that the flashing is installed correctly.

When using a rigid air barrier, the thickness of this also needs to be accounted for to achieve a flush finish when determining window set out and reveal depths.

Cemintel recommends installing a sub frame with all windows. Refer to typical window detail drawing in 'Construction Drawings and Details' section of this guide.

Eaves Junction

Air is circulated to the wall cavity. It is not recommended that air be vented into the roof space.

Control Joints

Movement Control Joints

Control joints provided in the panel layout should be aligned with movement control joints provided in the framing.

When undertaking building additions, a movement control joint must be installed at the junction of the existing framing and the new framing. Cladding systems must be discontinuous at this joint (refer to the "Construction Drawings & Details" section).

When setting out panels, design consideration should be given to the location of joints to ensure that minimum panel lengths are observed.

Horizontal Control Joints

A horizontal control joint is required beneath every floor junction to accommodate any expected deflection. The magnitude of the deflection must be verified by the project engineer (refer to the "Construction Details" section).

Vertical Control Joints

Vertical control joints to allow for differential movement are required at the supports of fascia trusses and at the junction of structural elements of different stiffness, such as between concrete

columns and stud frames (refer to the "Construction Drawings & Details" section).

A control joint must also be installed when a masonry wall adjoins framed construction, and at the junction of framed additions or existing buildings, to allow for differential movement. Refer to 'Construction Drawings & Details' section.

Vertical joints in panels must be aligned and extend for the full height of continuous panelling, although additional joints may be placed over openings for ease of installation. As the joints are expressed, consideration to the positioning of joints is important for aesthetic reasons. Placing joints at sides or above openings, or the use of full height windows can reduce the visual impact of joints.

NV9 Omega top hats have been designed to elastically deform when pressure is applied during panel fixing. They are designed to accept a vertical gasket tape which is made from closed cell foam with good weathering and UV resistance. It has a low compression set and low water permeability.

Structural Bracing

Cemintel Barestone panels are indirectly attached to the structural framing by way of metal top hats. As a consequence, they are **not** designed to provide wall bracing.

If required, bracing must be provided in the structural framing with methods such as sheet or strap bracing. Where sheet bracing is used, the entire wall framing to be clad with Barestone panels must be sheeted to maintain a uniform fixing plane.

Note: window setout will be affected.

Moisture Management

To ensure occupant health, safety and comfort and to protect the building frame from damage, a moisture strategy with the following objectives is required:

- Prevent external moisture entering the building; and
- Prevent the accumulation of internal moisture in a building.

Weatherproofing

Properly designed rigid air barriers including, fibre cement, masonry, concrete and timber may be utilised as an air barrier. The maximum serviceability wind pressure may be governed by the type of air seal/barrier selected.

The Barestone system has been tested and assessed to AS/NZS 4284 to withstand water ingress for serviceability wind loads of up to 2.5 kPa for the cavity system using Rigid Air Barriers.

DESIGN + AESTHETIC CONSIDERATIONS



Windows must be a front draining style and have appropriate flashing to prevent moisture ingress and penetrations should be effectively sealed at the air barrier and at the cladding.

Condensation

Condensation occurs as air cools and contacts cold surfaces that are below the air's dew point. Absorptive materials such as brick, cement sheet and timber are permeable and act as a buffering material until they become saturated, whilst non-absorptive materials such as steel and glass reach saturation quickly. Water can then accumulate and must be allowed to dry or drain away. Moist surfaces can result in health issues for occupants and lead to degradation of building materials and loss of structural integrity.

The likelihood and severity of condensation is largely a function of:

- Climate (primarily temperature and humidity including seasonal and diurnal variations)
- Occupancy and building use
- Material properties of the building envelope (including insulation material type and R-Value)
- Passive and mechanical ventilation
- Air tightness
- The building envelope's ability to allow or prevent the movement of vapour.
- The building envelope's ability to act as a water barrier behind the primary cladding element.

State of Clad recommends that architects/designers undertake a condensation risk analysis prior to selecting vapour control membranes. A rigid air barrier may be required where buildings are subject to higher wind loads, and in some climate zones may require the incorporation of a vapour barrier membrane in addition to the rigid air barrier. Greater use of insulation, better sealing to restrict air movement, and increased use of air conditioning leads to larger differences between the temperature and water vapour content of indoor environments and adjacent outdoor areas and greatly increases the risk of condensation at surfaces and interstitial spaces.

Rigid Air Barriers

All buildings require an air barrier to be installed. This may be fibre cement, ply wood or masonry. Installation for Cemintel fibre cement Rigid Air Barrier is detailed in the Cemintel Rigid Air Barrier Design and Installation Guide. Masonry substrates must be sealed to act as an air barrier for an effective waterproofing system. Wind forces can produce lower air pressures within buildings than on the outside, assisting to force water through gaps in the building envelope such as around penetrations and joints, even at low wind speeds.

The system incorporates a drained cavity, similar to brick veneer construction. This is highly effective at removing condensation and any incidental moisture from the cavity, thereby ensuring that the components within the cavity can dry out. The wall wrap or rigid air barrier must be installed in accordance with manufacturers instructions.

Condensation is a complex problem, and can occur under a variety of conditions, not just cold weather. Literature on this subject is available from BRANZ/MBIE and should be consulted when building in areas where condensation is likely to occur.

Insulation and Energy Efficiency

Thermal insulation values for walls must be calculated in order to meet the energy efficiency requirements of NZBC Clause H1.

Calculation tools are available (BRANZ) based on the methods of NZS 4218 for the total insulation values for walls, based on the climate zone (as shown in Appendix B of NZS 4218) and the construction R-values of the building wall elements.

Construction R-values should be calculated in accordance with NZS 4214 Methods of determining the total thermal resistance of parts of buildings.

Further information can be found in Acceptable Solution H1/AS1 and the BRANZ House Insulation Guide.



DESIGN + AESTHETIC CONSIDERATIONS

Fire Performance

Cemintel Barestone is not a fire rated system on its own, but can be used as part of a fire rated system. The cladding has been tested to ISO 5660 and meets the requirements of a Type A cladding as per table 5.1 of C/AS1 and table 5.5 of C/AS2.

Fire Rated Wall Construction

Cemintel Barestone can be used as part of a system to achieve a fire rated wall construction.

Extreme Climate Conditions

Corrosive Zones

Consideration of corrosivity zones should be taken into account. While Barestone panels are not susceptible to corrosion, consideration needs to be made regarding the impact of climate conditions on system components such as fasteners, clips and metal framing, for example.

Corrosivity zones are described in NZS 3604, with further information available in AS/NZS 2728 and E2/AS1. It is recommended that the building designer assess the site in accordance with the standards and local conditions to determine suitability of the system.

The Barestone system may be used in zones B, C and D except

for fixing to masonry which is limited to zones B & C. The System is not suitable for use in Zone E or in industrial and geothermal areas where the environment may be acidic with a pH of less than 5.

In all zones, all walls which are protected by soffits above must be washed down twice per year, to remove salt and debris buildup, particularly around window/door openings.

Temperature Extremes

Barestone External is not warranted for use in freezing conditions where the Barestone panel is in contact with snow drifts or extremely hot conditions (that is above 60°C).

Other Design Considerations

Services

The Cemintel Barestone system will accommodate services that are run through the framing. Any notches or holes formed must be considered in the framing design.

Renovations

When undertaking building renovations, remove all cladding, wall wrap and insulation from the original wall framing. Ensure the condition of the framing is in accordance with current requirements and is as true and as plumb as possible (within accepted industry tolerances of 5mm misalignment over 3000mm).

Install additional framing, insulation, air barrier and flashing as required.

Limitations

Cemintel Barestone is not warranted for the following applications:

- Panels with non-vertical face (e.g. parapet capping)
- Wet areas such as bathrooms
- Chimney cladding
- Exposure to surface temperatures greater than 60°C
- Non vented parapet cladding
- Contact with standing snow or ice
- Fixing of tiles or other materials to the face of the panels as the face is prefinished.

The above listing is not intended to be comprehensive. If in doubt, please contact State of Clad.



05

COMPONENTS + ACCESSORIES

05

COMPONENTS + ACCESSORIES

Note: Codes can change from time to time. Refer to the website for the current list of components prior to ordering.


Panels

Thickness (mm)	Width (mm)	Length (mm)	Mass (Nominal)	Panels per pallet
9	1200	3000	64.08 kg	20

Accessories


Accessories	Description	Size / Colour	Quantity	Product Code
-------------	-------------	---------------	----------	--------------

TOP HATS



The **NV9 Omega top hat** is a purpose designed aluminium section for supporting panels. The unique profile acts to accommodate movement of the sheets at the vertical joints. It is designed to be used in conjunction with NV9 Omega Centre Trim and gasket tape at panel joints. The NV9 Omega top hat is manufactured from 2.4mm aluminium.

3000mm 1 each 475354



The **NZ9 Omega Centre Trim** is used to support the panels at vertical joints. The NZ9 Omega Centre Trim is manufactured from aluminium.

3000mm 1 each 475355

FASTENERS



Barestone Rivet – for fixing Barestone panels to Top Hat framing. Each rivet comes with an already assembled EPDM (TPS-SEBS) gasket. Rivet heads are colour matched to the panel. Rivets are manufactured from stainless steel consisting of V4A (equivalent to 316 grade) stainless steel mandrels and V2A (equivalent to 304 grade) stainless steel sleeves.
Note: Use only the Cemintel Rivet and Rivet Gun Head. Standard rivets and gun heads are NOT ACCEPTABLE.

Colour matched to Cemintel Barestone panels
100 per pack
Original 474702
Ash 474590
Lunar 474592
Graphite 474589
4x18mm
Any - Stainless Steel 474703



NV9 SDA5 Screws - For fixing NZ9 Omega Rails to each other. 5.5x19mm A4 (316) Stainless Steel hex head self drilling screw.

500 per pack 475362



NV9 SX3 Timber Screws - For fixing NZ9 Omega Rails to timber framing. 6.5x60mm A4 (316) Stainless Steel hex head self drilling screw.

100 per pack 475358



NV9 SX3 Steel Screws - For fixing NZ9 Omega Rails to steel framing. 6x48mm A4 (316) Stainless Steel hex head self drilling screw.

500 per pack 475359



NV9 SX3 Masonry Screws - For fixing NZ9 Omega Rails to masonry structure. 10x85mm A4 (316) Stainless Steel hex head screw.

25 per pack 475360




NV9 SX3 Brick/Block Screws - For fixing NZ9 Omega Rails to Brick or Block structure. 10x80mm A4 (316) Stainless Steel hex head screw.

25 per pack 475361

Accessories	Description	Size / Colour	Quantity	Product Code
-------------	-------------	---------------	----------	--------------


GASKETS



NV9 Single Sided EPDM Tape - self-adhesive tape is made from EPDM closed cell foam which has high UV resistance. The gasket has adhesive on one side (with a release paper) and is adhered to the NV9 Omega Centre Trim to prevent moisture entry at vertical joints.


1.6mm x 24mm x 25m
Black 1 each 475357

BACKING STRIPS



NV9 Joint Backing Strip – a rolled aluminium section designed to deflect water and create an attractive expressed joint appearance at horizontal joints. Suitable only where a non-sealed façade system is appropriate.

3040mm 1 each 475363









NV9 Express Backing Strip - may be used in lieu of NV9 Joint Backing Strip for sealant filled system option.

6.5mm x 60mm x 3000mm 1 each 481749




COMPONENTS + ACCESSORIES

05






Note: Codes can change from time to time. Refer to the website for the current list of components prior to ordering.


	ExpressWall Backing Strip – may be used in lieu of Barestone Angled Backing Strip for sealant filled system option.	1194mm 2394mm 2994mm	1 each 1 each 1 each	474521 474520 474499
	Bond Breaker Tape – Required where horizontal joints are sealed.			Supplied by others
OTHER				
	NV9 Internal Corner Closer – Aluminium angle flashing used at internal corners. Manufactured from aluminium and powder coated to one side.	3000mm	1 each	475356
	NV9 External Corner Closer – Aluminium angle flashing used at external corners. Manufactured from aluminium and powder coated to one side.	3000mm	1 each	481747
	Adhesive – for fixing spacer at head junction. Sikaflex 11FC Grey For use as a backing strip adhesive when installing ExpressWall Backing strips			Supplied by others
	Sealant – is used to seal joints for control joints, junctions etc. Sikaflex Sealant PRO-2HP Grey			Supplied by others
	Backing Rod – for sealant backing – used to enable correct filling of joints with sealant. Also used as an air seal at window openings and construction junctions. The diameter of backing rod must be appropriate for the width of the gap being filled.			Supplied by others
	Cemintel Edge Sealer – for sealing panel edges after on-site cutting.	200ml	1 each	186529

TOOLS – When using Barestone Rivets the following tools must be used

	Barestone Drill Bit Ø 9.5mm – for drilling accurate holes in the Barestone panel to accept the Barestone rivet. Fits standard 10mm drill chuck.		1 each	474527
	Barestone Drill Bit Ø 4.1mm – for use with Rivet Centralising Tool to drill accurate rivet holes into the Top Hats		5 per pack	474529
	Barestone Rivet Centralising Tool – for drilling accurate rivet holes in the top hats. Fits a 10mm drill chuck to ensure that the 4.1mm rivet hole is perfectly centred in the pre-drilled panel.		1 each	474528
	Barestone Rivet Gun Nose Piece – required to achieve the correct rivet fixing and offset. Attaches to the Milwaukee and Gesipa Accubird battery operated, blind rivet gun and ensures the correct spacing of the rivet head from the panel face. Also designed to seat the larger rivet head correctly and prevent damage to the coloured rivet head. Note: Standard rivet gun nose piece is NOT ACCEPTABLE		1 each	474530

Other Tools

Product	Description	Size	Quantity	Product Code
	Barestone Blind Rivet Gun – Cemintel recommends the use of the Milwaukee and GESIPA® Accubird Battery Operated Blind Rivet Gun			Supplied by others
	Makita Plunge Saw Kit (1300W) includes 1400mm guide rail and bonus 165mm fibre cement saw blade – excellent for cutting cement based sheets. Must be used with a dust extraction system.	165mm	1	Supplied by others
	Makita 165mm Fibre Cement Saw Blade – ideal for use with the Makita Plunge saw and other 165mm circular saws fitted with vacuum extraction systems	165mmx20x4T	1	Supplied by others
	Dust Extraction		1	Supplied by others
	Grinder Tool		1	Supplied by others

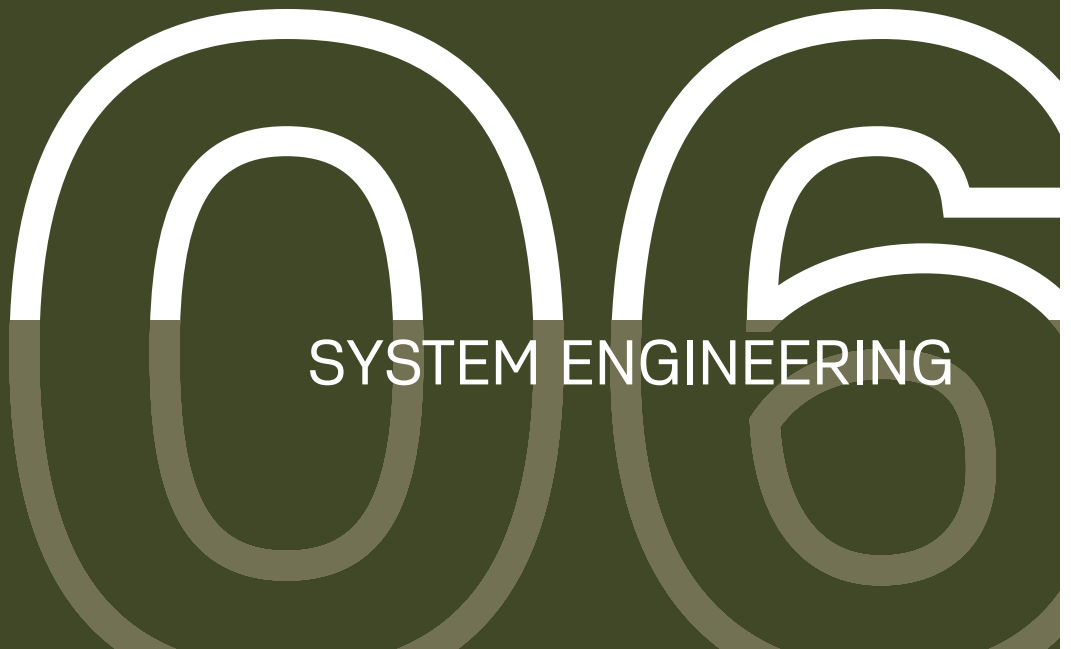

SYSTEM ENGINEERING

SYSTEM ENGINEERING



Design, Detailing And Performance Responsibilities

Barestone System

Cemintel engages independent testing laboratories to test and report on the performance of a wall in accordance with the relevant New Zealand Standards. Consultants with relevant experience will use these test reports to provide opinions and assessments that extend the tested arrangement to include various on-site installation configurations and details that meet appropriate criteria performance.

Project Consultants (Structural, Fire, Acoustic, Etc.)

These consultants are typically responsible for the following:

- Opinions on expected laboratory performance of wall configurations that vary from actual test configuration, such as substitution products and components.
- Judgements about expected field performance using laboratory test reports and practical experience.
- Design, specification and certification of structural, fire, acoustic, durability, weather tightness and any other required performance criteria for individual projects.

This involves the design and selection of building elements, such as wall and floors and their integration into the building considering the following:

- Interface of different building elements and to the structure / substrate.
- Wall and floor junctions.
- Penetrations.
- Flashing issues.
- Room / building geometry.
- Acoustic and water penetration field-testing.

Design Responsibility

Panels, top hats and structural framing are required to resist wind loads that are specific to the building site. Additional 'local pressure factors' can apply to the panels and top hats in accordance with the wind code AS/NZS 1170.2. It is recommended that the Architect/Building Designer assigns the responsibility for the facade design to the Project Engineer. Once wind loads have been determined, top hat spans, fastener spacings, and sheet fixing details may be selected from the appropriate tables in this manual.

It is also the responsibility of the Architect/Building Designer to select the appropriate corrosivity category. Refer to appropriate details in this guide.

The performance levels of walls documented in this guide are either what is reported in a test or the documented opinion of consultants. Performance in projects is typically the responsibility of:

Project Certifier and/or Builder

These professionals are typically responsible for:

- Identifying the performance requirements for the project in accordance with the NZBC and clearly communicating this to the relevant parties.
- Applicability of any performance characteristics supplied by Cemintel including test and opinions for the project.
- The project consultants' responsibilities detailed above if one is not engaged in the project.

Cemintel and State of Clad do not provide consulting services. Cemintel only provides information that has been prepared by others and therefore shall not be considered experts in the field.

Any party using the information contained in this guide or supplied by Cemintel and State of Clad in the course of a project must satisfy themselves that it is true, current and appropriate for the application, consequently accepting responsibility for its use.

It is the responsibility of the Architect/Building Designer and engineering parties to ensure that the details in this design guide are appropriate for the intended application.

The recommendations in this guide are formulated along the lines of good building practice, but are not intended to be an exhaustive statement of all relevant data.

Cemintel is not responsible for the performance of constructed walls, including field performance, and does not interpret or make judgements about performance requirements in the NZBC in a specific project application.

Note: it is the responsibility of the Project Engineer to specify the connection of the top hats to the support structure. It is also the responsibility of the Project Engineer to calculate the wind loads for the cladding of a project.



SYSTEM ENGINEERING

Design, Detailing And Performance Responsibilities

Cemintel Barestone System

Cemintel have engaged independent testing laboratories to test and report on the performance of a wall in accordance with the relevant New Zealand Standards. Consultants with relevant experience will use these test reports to provide opinions and assessments that extend the tested arrangement to include various on-site installation configurations and details that meet appropriate criteria performance.

Project Consultants (Structural, Fire, Acoustic, Etc.)

These consultants are typically responsible for the following:

- Opinions on expected laboratory performance of wall configurations that vary from actual test configuration, such as substitution products and components.
- Judgements about expected field performance using laboratory test reports and practical experience.
- Design, specification and certification of structural, fire, acoustic, durability, weather tightness and any other required performance criteria for individual projects.

This involves the design and selection of building elements, such as wall and floors and their integration into the building considering the following:

- Interface of different building elements and to the structure / substrate.
- Wall and floor junctions.
- Penetrations.
- Flashing issues.
- Room / building geometry.
- Acoustic and water penetration field-testing.

Design Responsibility

Panels, top hats and structural framing are required to resist wind loads that are specific to the building site. Additional 'local pressure factors' can apply to the panels and top hats in accordance with the wind code AS/NZS 1170.2. It is recommended that the Architect/Building Designer assigns the responsibility for the facade design to the Project Engineer. Once wind loads have been determined, top hat spans, fastener spacings, and sheet fixing details may be selected from the appropriate tables in this manual. It is also the responsibility of the Architect/Building Designer to select the appropriate corrosivity category. Refer to appropriate details in this guide.

The performance levels of walls documented in this guide are either what is reported in a test or the documented opinion of consultants. Performance in projects is typically the responsibility of:

Project Certifier and/or Builder

These professionals are typically responsible for:

- Identifying the performance requirements for the project in accordance with the NZBC and clearly communicating this to the relevant parties.
- Applicability of any performance characteristics supplied by Cemintel including test and opinions for the project.
- The project consultants' responsibilities detailed above if one is not engaged in the project.

Cemintel and State of Clad do not provide consulting services. Cemintel and State of Clad only provides information that has been prepared by others and therefore shall not be considered experts in the field.

Any party using the information contained in this guide or supplied by Cemintel and State of Clad in the course of a project must satisfy themselves that it is true, current and appropriate for the application, consequently accepting responsibility for its use.

It is the responsibility of the Architect/Building Designer and engineering parties to ensure that the details in this design guide are appropriate for the intended application.

The recommendations in this guide are formulated along the lines of good building practice, but are not intended to be an exhaustive statement of all relevant data.

Cemintel is not responsible for the performance of constructed walls, including field performance, and does not interpret or make judgements about performance requirements in the NZBC in a specific project application.

Note: it is the responsibility of the Project Engineer to specify the connection of the top hats to the support structure. It is also the responsibility of the Project Engineer to calculate the wind loads for the cladding of a project.

Stud Wall support framing

NV9 Omega rails can be fixed to vertical structurally designed timber SG8 or higher grade, or steel support framing of minimum 0.5mm BMT for residential projects within the scope of NZS 3604 and 1.2mm BMT for projects outside of NZS 3604.

SYSTEM ENGINEERING



Barestone Residential Tables - General Zones (areas greater than 1200mm from building corner)

TABLE 6.01

Wind Class (NZS 3604)	Stud spacing (mm)	Cladding Fixing Spacing (mm)	Spacing of vertical Top hat (mm)			
			300	400	450	600
			Spacing of horizontal top hat (mm)			
Low	300	600	1900	1700	1650	1500
	400	600	1900	1700	1650	1500
	450	600	1900	1700	1650	1500
	600	600	1900	1700	1650	1500
Medium	300	600	1700	1550	1500	1350
	400	600	1700	1550	1500	1350
	450	600	1700	1550	1500	1350
	600	600	1700	1550	1500	1350
High	300	600	1500	1350	1300	1200
	400	600	1500	1350	1300	1200
	450	600	1500	1350	1300	1200
	600	600	1500	1350	1300	1200
Very High	300	500	1400	1250	1200	1100
	400	500	1400	1250	1200	1100
	450	500	1400	1250	1200	1100
	600	500	1400	1250	1200	1100
Extra High	300	400	1300	1200	1150	1000
	400	400	1300	1200	1150	1000
	450	400	1300	1200	1150	1000
	600	400	1300	1200	1150	1000

Notes:

- Steel Stud framing is assumed to be grade G550 for 0.5 BMT and 0.75 BMT steel or grade G2 for 1.2 BMT steel. All stud framing shall be designed in accordance with AS/NZS 4600:2018.
- Timber Stud framing is assumed to be SG8 timber conforming with NZS 3622:2004 with a J5 joint group assuming dry timber in accordance with NZS 3603:1993.
- Fixing between horizontal top hat and stud to be 2/NV9 SX3 Steel Screws or 2/NV9 SX3 Timber Screws. Where fixing to other substrates, two fixings shall be provided at the stud spacing with a pull out/over ultimate capacity of ≥ 1.14 kN per single fixing.
- Fixing between horizontal and vertical top hats to be 1/NV9 SDA5 Screw per intersection of members where the second layer is inverted or 2/NV9 SDA5 Screws otherwise.
- Fixing between vertical top hat and cladding to be a single Barestone Rivet fastener. Panels fixed to three vertical top hats.
- Maximum cantilever is 0.2 x adjacent span



SYSTEM ENGINEERING

Barestone Residential Tables - Corner Zones (areas less than 1200mm from building corner)

TABLE 6.02

Wind Class (NZS 3604)	Stud spacing (mm)	Cladding Fixing Spacing (mm)	Spacing of vertical Top hat (mm)			
			300	400	450	600
			Spacing of horizontal top hat (mm)			
Low	300	600	1500	1400	1350	1200
	400	600	1500	1400	1350	1200
	450	600	1500	1400	1350	1200
	600	600	1500	1400	1350	1200
Medium	300	450	1400	1250	1200	1100
	400	450	1400	1250	1200	1100
	450	450	1400	1250	1200	1100
	600	450	1400	1250	1200	1100
High	300	350	1250	1100	1050	800
	400	350	1250	1100	1050	800
	450	350	1250	1100	1050	800
	600	350	1250	1100	1050	800
Very High	300	250	1100	950	850	650
	400	250	1100	950	850	650
	450	250	1100	950	850	650
	600	250	1100	950	850	650
Extra High	300	200	1050	800	700	500
	400	200	1050	800	700	500
	450	200	1050	800	700	500
	600	200	1050	800	700	500

Notes:

- Steel Stud framing is assumed to be grade G550 for 0.5 BMT and 0.75 BMT steel or grade G2 for 1.2 BMT steel. All stud framing shall be designed in accordance with AS/NZS 4600:2018.
- Timber Stud framing is assumed to be SG8 timber conforming with NZS 3622:2004 with a J5 joint group assuming dry timber in accordance with NZS 3603:1993.
- Fixing between horizontal top hat and stud to be 2/NV9 SX3 Steel Screws or 2/NV9 SX3 Timber Screws. Where fixing to other substrates, two fixings shall be provided at the stud spacing with a pull out/over ultimate capacity of ≥ 1.14 kN per single fixing.
- Fixing between horizontal and vertical top hats to be 1/NV9 SDA5 Screw per intersection of members where the second layer is inverted or 2/NV9 SDA5 Screws otherwise.
- Fixing between vertical top hat and cladding to be a single Barestone Rivet fastener. Panels fixed to three vertical top hats.
- Maximum cantilever is 0.2 x adjacent span

SYSTEM ENGINEERING



Surround Commercial Tables

TABLE 6.03

Ultimate wind load (kPa)	Stud spacing (mm)	Cladding Fixing Spacing (mm)	Spacing of vertical Top hat (mm)			
			300	400	450	600
			Spacing of horizontal top hat (mm)			
1.00	300	500	1400	1300	1250	1100
	400	500	1400	1300	1250	1100
	450	500	1400	1300	1250	1100
	600	500	1400	1300	1250	1100
1.25	300	425	1300	1200	1150	1000
	400	425	1300	1200	1150	1000
	450	425	1300	1200	1150	1000
	600	425	1300	1200	1150	1000
1.50	300	350	1250	1100	1050	800
	400	350	1250	1100	1050	800
	450	350	1250	1100	1050	800
	600	350	1250	1100	1050	800
1.75	300	300	1150	1050	950	700
	400	300	1150	1050	950	700
	450	300	1150	1050	950	700
	600	300	1150	1050	950	700
2.00	300	250	1100	950	800	600
	400	250	1100	950	800	600
	450	250	1100	950	800	600
	600	250	1100	950	800	600
2.25	300	225	1050	800	750	550
	400	225	1050	800	750	550
	450	225	1050	800	750	550
	600	225	1050	800	750	550
2.50	300	200	1000	750	650	500
	400	200	1000	750	650	500
	450	200	1000	750	650	500
	600	200	1000	750	650	500
2.75	300	175	900	650	600	Not Suitable
	400	175	900	650	600	Not Suitable
	450	175	900	650	600	Not Suitable
	600	175	900	650	600	Not Suitable
3.00	300	150	800	600	550	Not Suitable
	400	150	800	600	550	Not Suitable
	450	150	800	600	550	Not Suitable
	600	150	800	600	550	Not Suitable
3.50	300	200	700	500	Not Suitable	Not Suitable
	400	200	700	500	Not Suitable	Not Suitable
	450	200	700	500	Not Suitable	Not Suitable
	600	200	700	500	Not Suitable	Not Suitable
4.00	300	150	600	450	Not Suitable	Not Suitable
	400	150	600	450	Not Suitable	Not Suitable
	450	150	600	450	Not Suitable	Not Suitable
	600	150	600	450	Not Suitable	Not Suitable
5.00	300	150	500	350	Not Suitable	Not Suitable
	400	150	500	350	Not Suitable	Not Suitable
	450	150	500	350	Not Suitable	Not Suitable
	600	150	500	350	Not Suitable	Not Suitable
6.00	300	100	400	300	Not Suitable	Not Suitable
	400	100	400	300	Not Suitable	Not Suitable
	450	100	400	300	Not Suitable	Not Suitable
	600	100	400	300	Not Suitable	Not Suitable

Notes:

- Steel Stud framing is assumed to be grade G2 for 1.2 BMT steel. All stud framing shall be designed in accordance with AS/NZS 4600:2018.
- Timber Stud framing is assumed to be SG8 timber conforming with NZS 3622:2004 with a J5 joint group assuming dry timber in accordance with NZS 3603:1993.
- Fixing between horizontal top hat and stud to be 2/NV9 SX3 Steel Screws or 2/NV9 SX3 Timber Screws. Where fixing to other substrates, two fixings shall be provided at the stud spacing with a pull out/over ultimate capacity of ≥ 1.14 kN per single fixing.
- Fixing between horizontal and vertical top hats to be 1/NV9 SDA5 Screw per intersection of members where the second layer is inverted or 2/NV9 SDA5 Screws otherwise.
- Fixing between vertical top hat and cladding to be a single Barestone Rivet fastener. Panels fixed to three vertical top hats.
- Maximum cantilever is 0.2 x adjacent span



SYSTEM ENGINEERING


NV9 Omega Rail Spacings

The design capacities of the Cemintel Barestone façade system are in limit state format and intended for use with AS/NZS 1170.2.

To obtain equivalent permissible load capacity, divide the “ultimate wind capacity” in Table 6.03 by 1.5.


The deflection of the top hats as detailed in these tables is no more than $\text{span}/250$ when subjected to serviceability wind load of 68% of ultimate wind loads.

FIGURE 6.01 Double Top Hat Span Installation

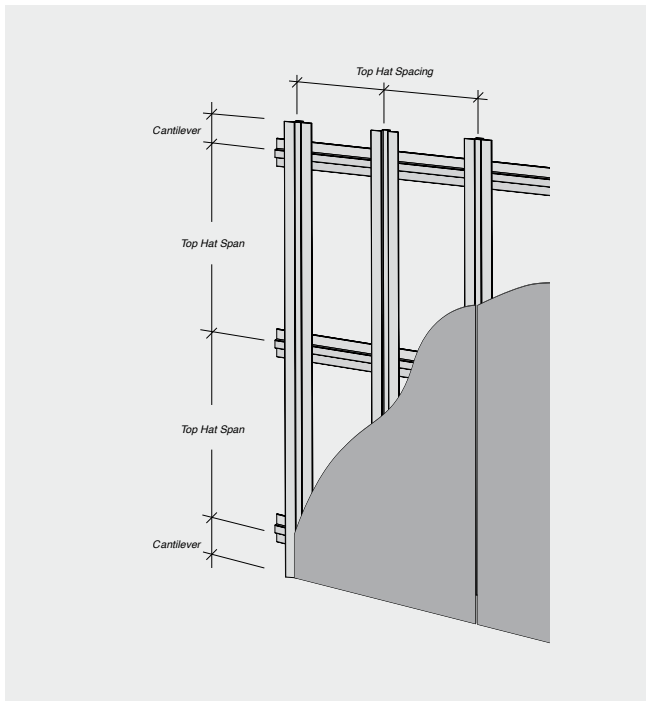

Panel Fixing Requirements

FIGURE 6.02 Vertical Sheet Fixing

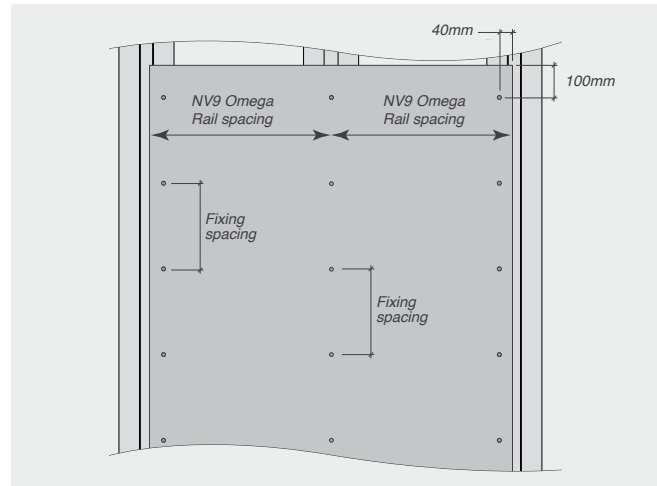



07

INSTALLATION

CHECKLIST – Prior to Installation

The following pre-install checklist may assist to ensure you have the best possible outcome when using Barestone External.

- Ensure substrate is straight and plumb. Pack studs to straighten if necessary (timber frames as per NZS 3604, steel frames as per AS/NZS 4600). Industry best practice for frame tolerance is 5mm misalignment over 3000mm.
- Ensure studs are correctly located and of the appropriate thickness.
- Confirm bracing is in place. Where sheet bracing is used behind panels, the entire wall area needs to be braced or bracing sheet packers fixed to the frame to ensure a uniform fixing plane.
- Remove any concrete that may foul the cladding line, particularly at steps in slabs and isolated columns.
- Ensure there is adequate ground clearance to the bottom edge of the Barestone panels as per regulatory requirements (including for water/rain runoff and termite management). These can vary from 100-175mm depending on type of ground.
- Confirm your panel layout to determine the location of joints and identify where additional studs are required.
- Flashings, membranes and air barrier should be correctly installed, overlapped and taped at joints, prior to fixing panels.
- Install windows so that the back of the front face of the window (or any other protrusions including doors or meter boxes) will be flush with the face of the panels.
- Fit Head flashings over windows, doors and other penetrations.
- Confirm the chosen eaves/soffit details and prepare accordingly.
- Consider the need for structural support for fixtures such as pergolas and balconies. No loads may be carried by the cladding.
- Confirm membranes and flashings for balcony areas have been installed in accordance with manufacturers' specifications.
- Arrange for a pre-cladding inspection by the appropriate local building consent authority if required.



Check quality and quantity of panels and components before installing. If there is any sign of damage or visible defects in panels, or the colour/finish is not in keeping with the owner's aesthetic requirements DO NOT INSTALL. Contact State of Clad to address any issues.



Installation Set-Out

Appropriate panel fixing layout and top hat spacing should be suitable for the project design wind pressure. It is recommended that fasteners be fixed 100mm from the top and bottom edges of the panel and 40mm in from the side of the panels.

FIGURE 7.01 Horizontal Sheet Fixing


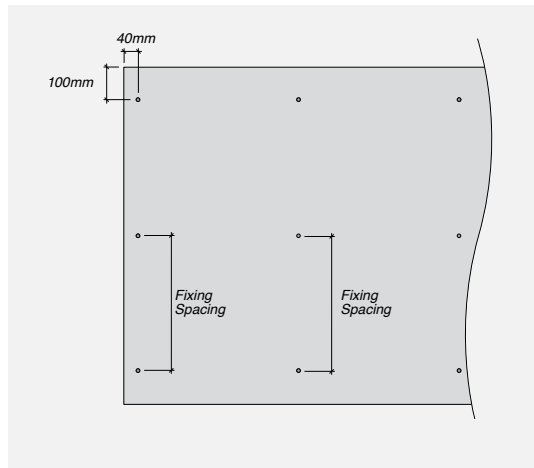


FIGURE 7.02 Vertical Sheet Fixing

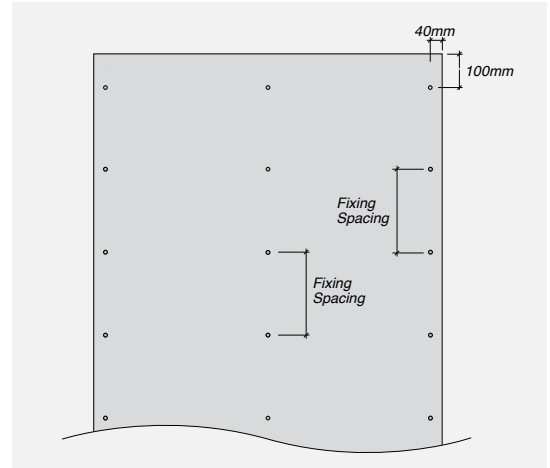

Panels must be fixed in accordance with the tables set out in 'System Engineering' Section. This provides fixing Requirements and Maximum Rail Spacings for 1200mm wide panels based on 2 rails or 3 or more rails.

Installation for Timber and Steel Framing

Refer to 'System Engineering' and 'Construction Drawings and Details' sections for specific fixing information.

Step 1 – Install air barrier – as per Manufacturer's instructions.

Step 2 – Fix base flashing to base of wall over rigid air barrier taping top edge of flashing to air barrier.

Step 3 – Fix rails. Fix NV9 Omega rails horizontally where required to substrate as per 'System Engineering' section requirements. Fix NV9 Omega Rails vertically to horizontal rails as per 'System Engineering' section requirements.

Step 4 – Prepare panels. Cut panels as required. Run a fine sandpaper block along the edge of the cut panel (taking care not to scratch the panels surface). Seal cut edges with Cemintel's recommended edge sealant to protect against moisture entering the panels.

Step 5 – Pre-drill panel holes. This should be done prior to lifting panels into place and can be done off site. Panel holes need to be drilled a minimum 100mm from the horizontal edge and a minimum of 40mm from the vertical edge (refer to 'System Engineering Section').


For Barestone rivets, use the recommended Cemintel

9.5mm carbide tipped drill bit with centreing tip (Refer Fig. 7.03).

The size of the hole drilled is designed to match the size of the rivet rubber sleeve. The use of other tools for this purpose may reduce fixing capacity and reduce the weather resistance of the system. DO NOT use hammering action when drilling. For efficiency you can neatly stack 3 or 4 sheets and drill through all at the same time. Take care to avoid damaging the panel with the drill chuck when approaching the end of the hole by using a timber block.

Clean/sweep away any dust from holes as this can stick to the panel.

FIGURE 7.03 Pre-drilling Panels

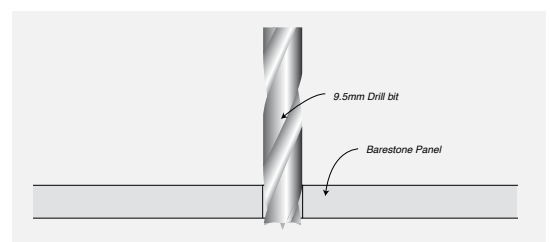

07

INSTALLATION

Step 6 – Install Vertical gaskets to the NV9 Omega Centre Trim installed into the NV(Omega Rails rails for the full extent of panels. Take care not to stretch the gasket when installing (Refer Fig. 7.04). When joining gasket, cut ends cleanly and push together before adhering. When the NV9 Omega Rails and Centre Trims are discontinuous, butt ends together tightly

and continue gasket over the joint. At the beginning and end of a vertical joint, such as with sheets installed in a half-bond pattern, continue the vertical gasket past the horizontal joint by 100mm minimum (Refer Fig. 7.05).

FIGURE 7.04 Vertical Gasket




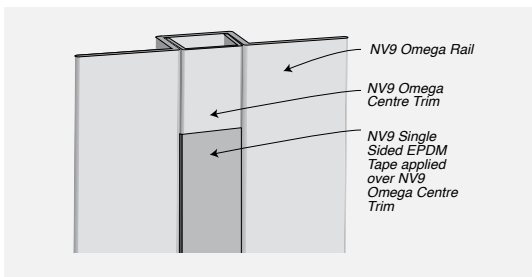


FIGURE 7.05 Vertical Gasket and Fixing Detail for Half-Bond Panel Layout

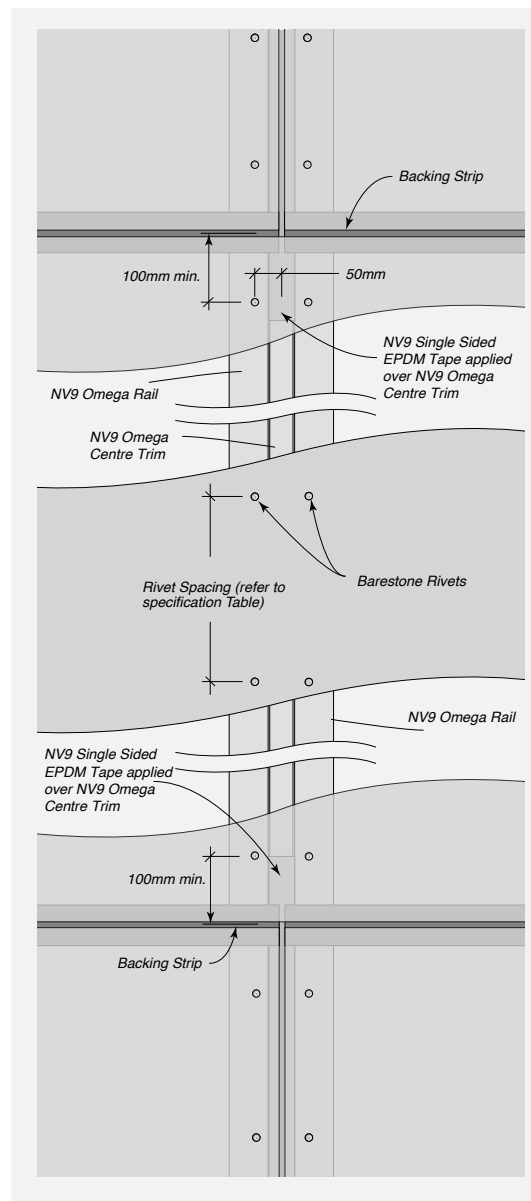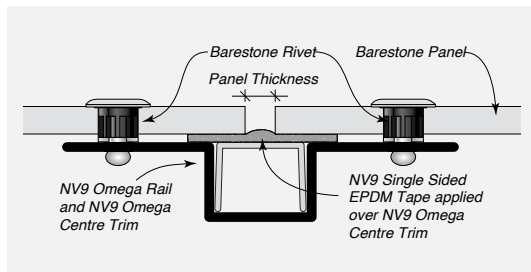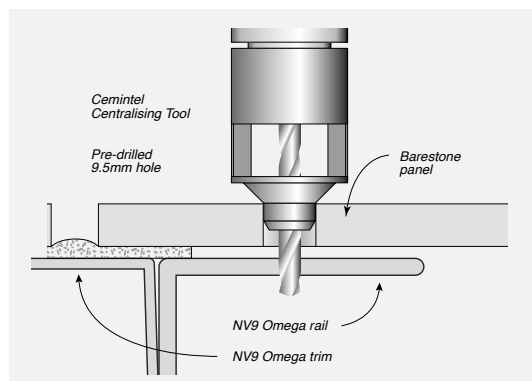

INSTALLATION

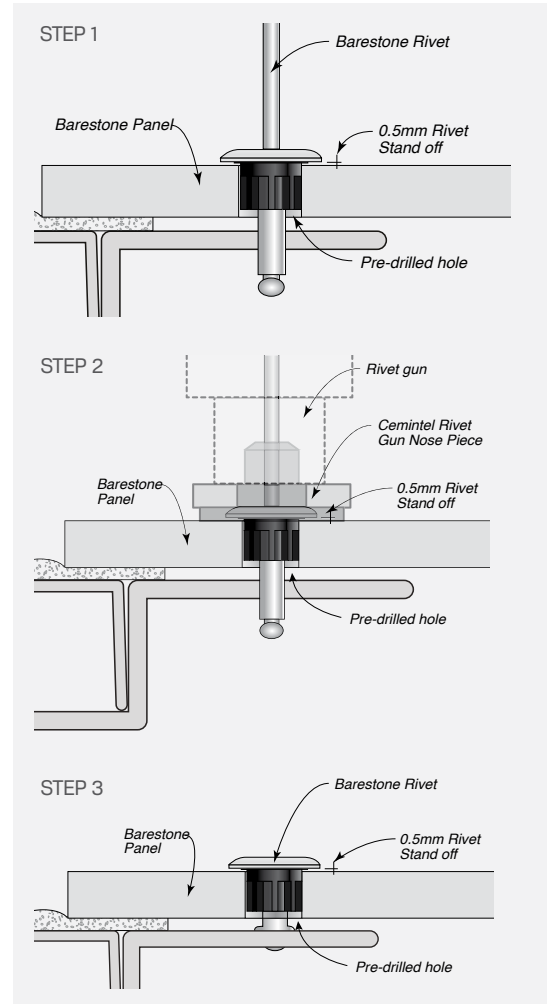
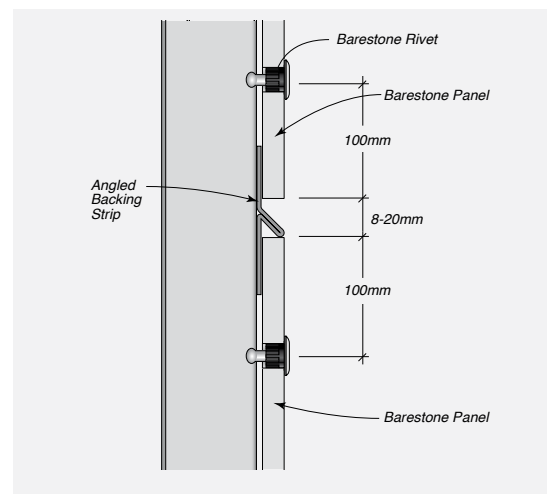
07

FIGURE 7.07 Vertical Joint Detail – Rivet Fixed**FIGURE 7.06** Centralising Tool**Step 7 – Install wall panels.**

Fixing panel – Lift panel into place, clamp down level to identify horizontal and vertical planes. Using the Rivet Centralising Tool, drill 4.1mm rivet holes through the pre-drilled panel holes into the top hats. This specialised tool creates a rivet hole, which matches the size of the shaft of the rivet, precisely in the centre of the panel hole (Refer Fig. 7.08).

Install Rivet Gun nose piece onto the Gesipa Accubird or Milwaukee battery operated blind rivet gun. The nose piece has a slight concave shape which serves to create a small (0.5mm) clearance between the panel face and the rivet flange. This enables differential movement of the frame while reducing damage to the panel face. Fix panel starting at the bottom corner. Place the rivet gun with the rivet gun head onto the rivet shaft. Push the panel firmly against the framing/gaskets and operate the gun to pull the rivet through panel hole into the predrilled top hat.

Before fixing top rivets to panel, insert Barestone Angled Backing Strip along horizontal joint. Clip corners at an angle and bend. Barestone Panels

FIGURE 7.08 Fixing with Rivets**FIGURE 7.09** Horizontal Joint with Angled Backing Strip

07

INSTALLATION

are generally installed with a nominal 8-10mm wide expressed joint in both horizontal and vertical directions (a small cut piece of panel can be used as a spacer to easily measure joint widths and ensure consistency). Once positioned, fasten top row of rivets.

Sealant filled joints only – When using the ExpressWall backing strip, ensure ExpressWall backing strip is 6mm shorter overall than the width of the panel (cut to length if necessary).

A fillet of Sikaflex 11FC is then placed along the top edge of the panel. This ensures that the joint drains

and salt and dirt do not build up in the joint.

To seal the groove in the backing strip at the ends, apply a small section of gasket to the rear of the backing strip. This will be forced into the recess and seal the end of the strip. Alternatively use Sikaflex 11FC to fill the groove.

Joint widths – While panels are generally installed with a nominal 8-10mm wide horizontal and vertical expressed joint. However joints up to 20mm can be formed provided additional care is taken during installation to ensure that panel edges cover the joint gaskets by a minimum of 10mm.

FIGURE 7.10 Backing Strip Positioning

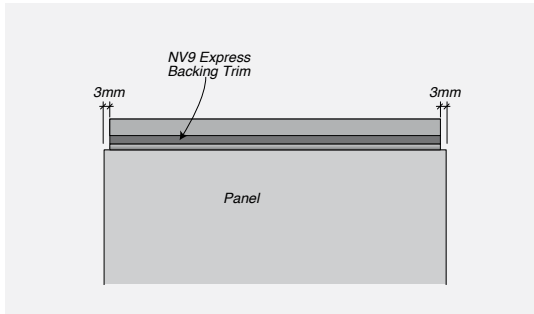


FIGURE 7.11 Horizontal Joint

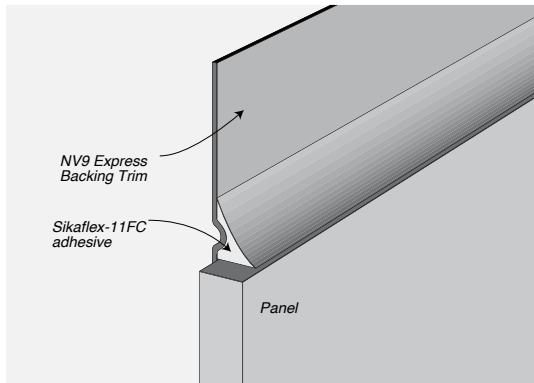


FIGURE 7.12 Sealing Ends of Backing Strip

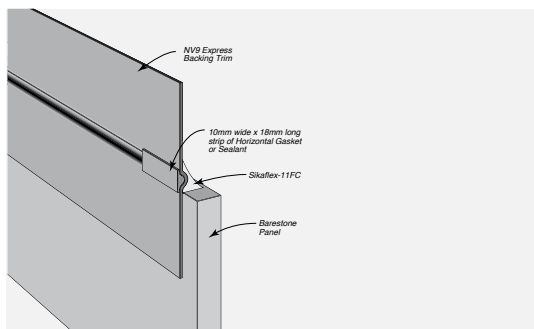


FIGURE 7.13 Vertical Joint


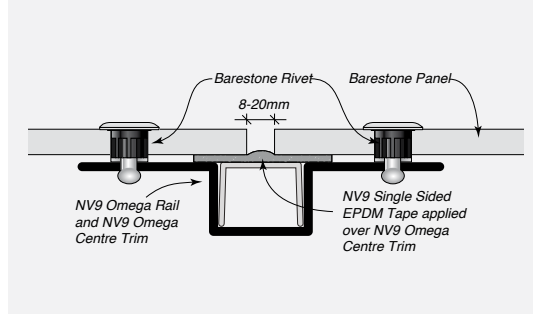


FIGURE 7.14 Horizontal Joint

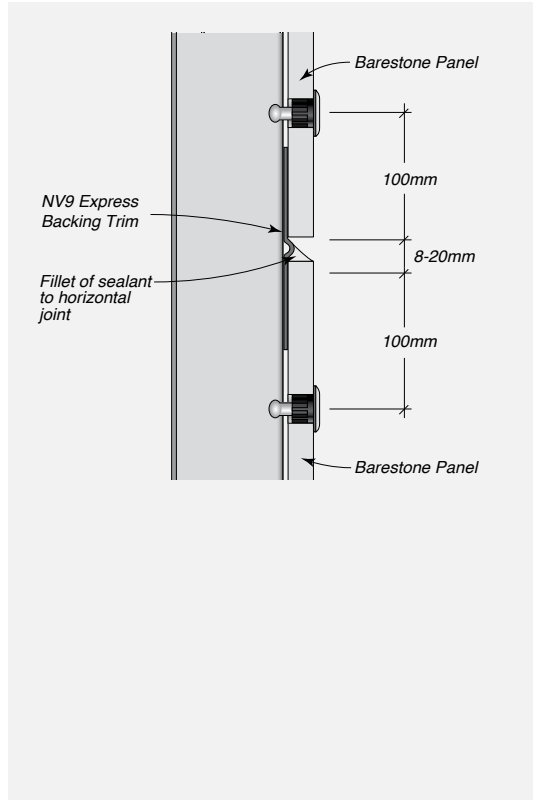


INSTALLATION

07

In certain conditions such as corrosive environments or where there is a preference to have flush sealed joints, horizontal and vertical joints may be filled with recommended joint sealant and in accordance with manufacturer's instructions. Base of walls including horizontal joints at inter-storey junctions must

remain open, to allow pressure equalisation to be maintained and for any water moisture to drain from the cavity. Refer to the sealant filled joint details of the "Construction Drawings and Details" section of this manual.

FIGURE 7.15 Joint Construction – Sealed Option

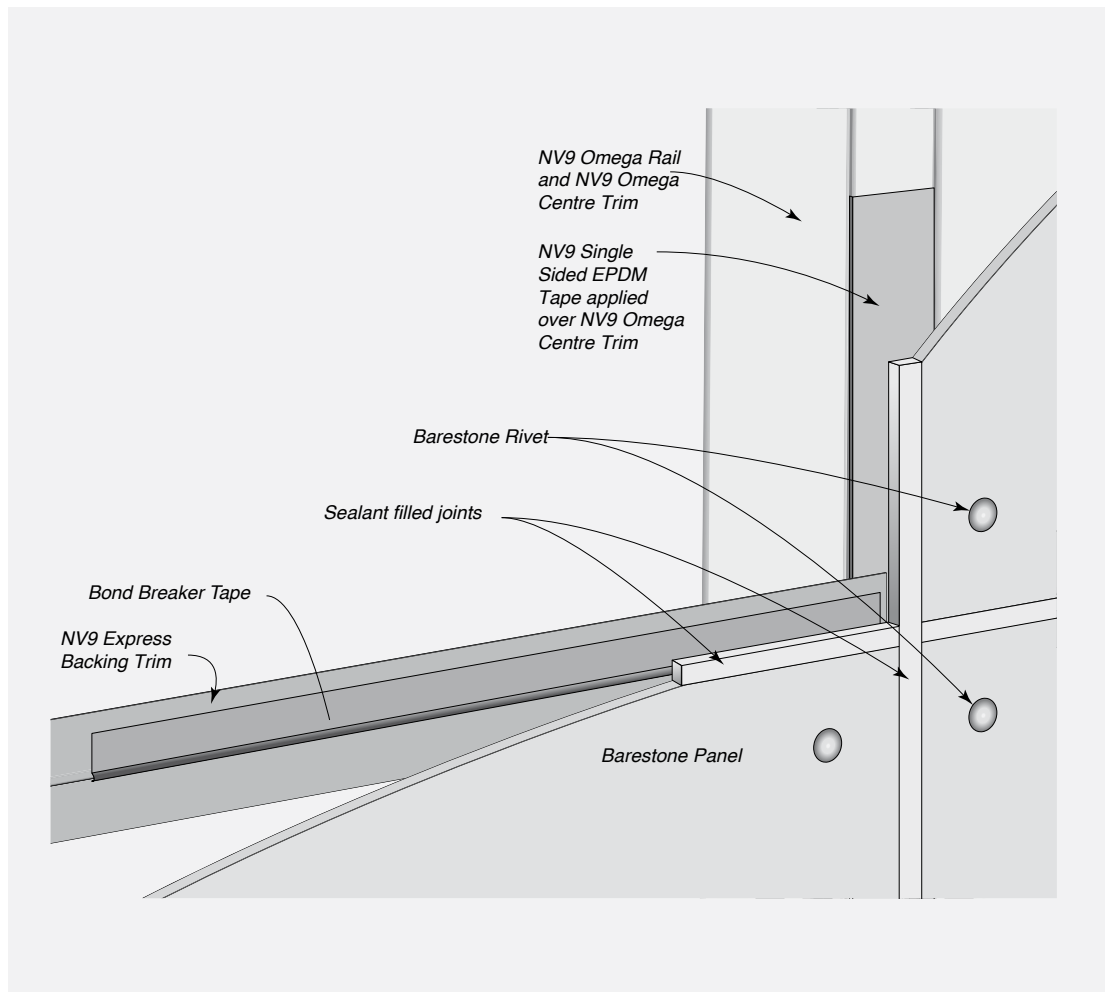

07

INSTALLATION

FIGURE 7.16 Horizontal Joint Sealed Side

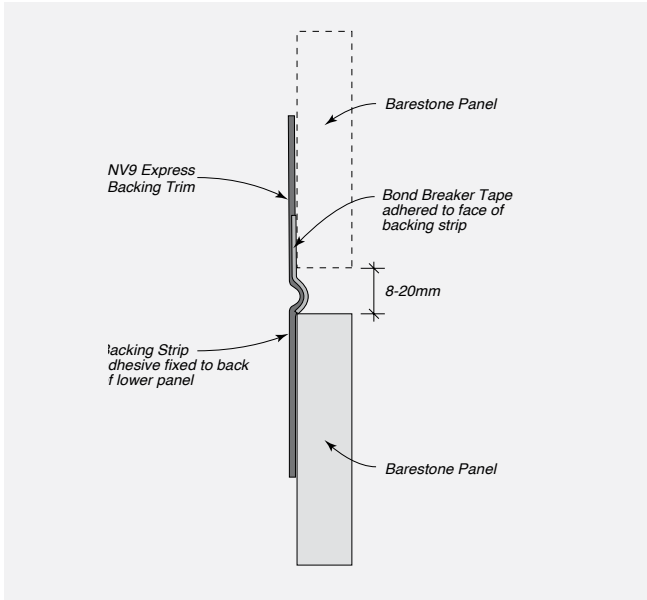


FIGURE 7.19 Horizontal Joint Sealed Side

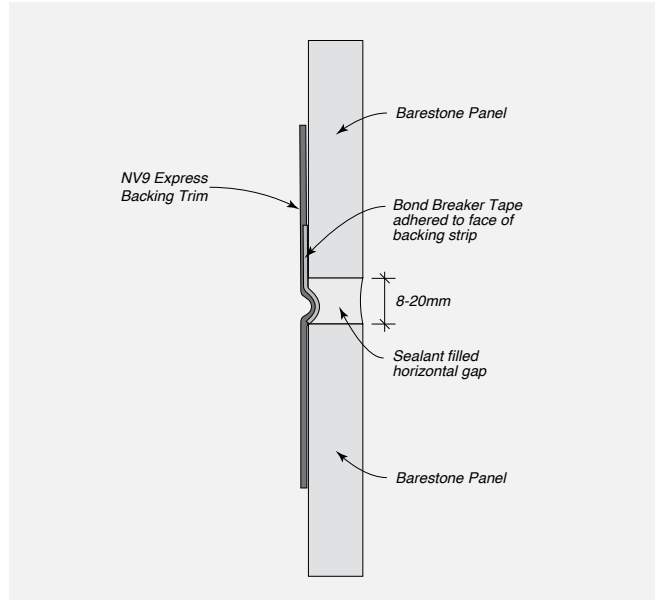


FIGURE 7.17 Horizontal Joint Fixing – Sealed Option

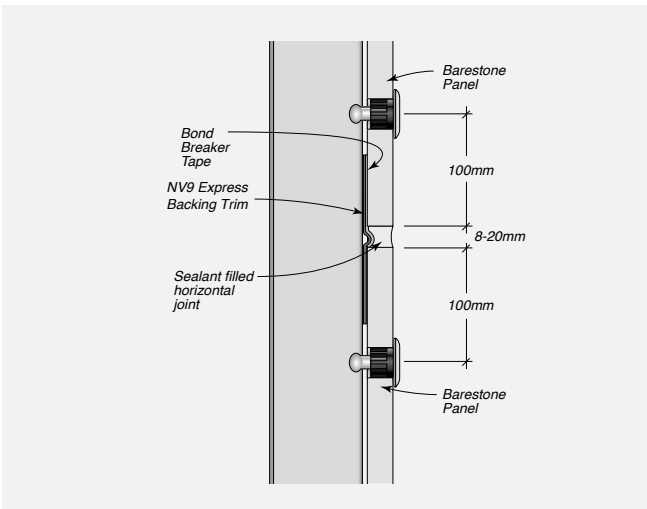


FIGURE 7.20 Backing Strip & Bond Breaker Tape


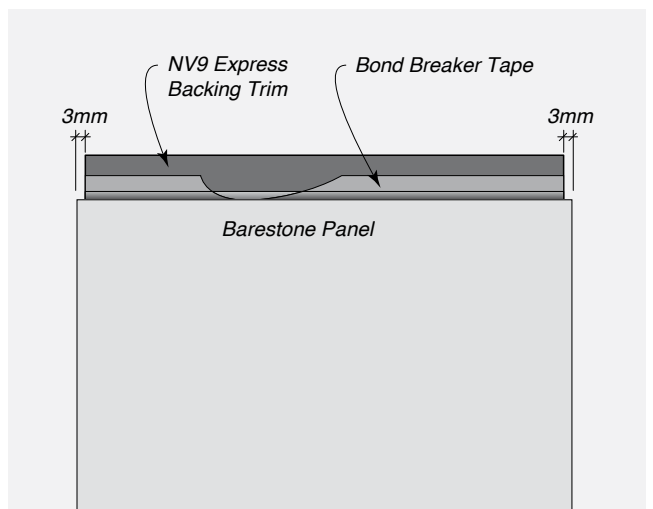


FIGURE 7.18 Vertical Joint – Sealed Option





CONSTRUCTION DETAILS

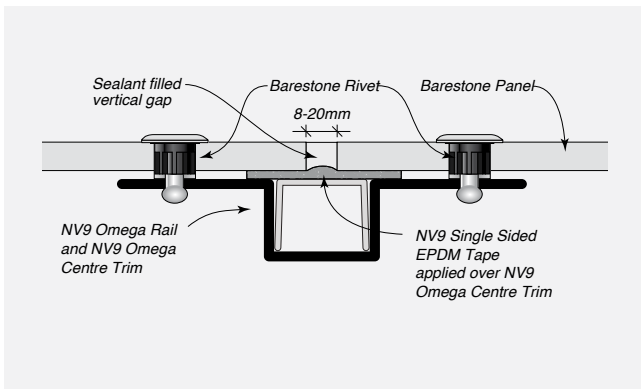

CONSTRUCTION DETAILS

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.


Drawings Index

SECTION	DESCRIPTION	FIGURE REFERENCE	PAGE NUMBER
VENTILATED CAVITY SYSTEM			
Overview	Joint Construction – Ventilated Cavity System	8.01	37
Joint Details	10mm Horizontal Joint – Sealant Filled and Screw Fixed	8.02	38
	Horizontal Joint – Angled Backing Strip	8.03	38
	Vertical Joint – Rivet	8.04	38
Cross Section Details	Typical System Cross Section for Steel Framing	8.05	39
Head Details	Eaves/Deflection Head – Ventilated	8.06	39
Base Details	Base Detail – Drained	8.07	39
Corner Details	External Corner	8.08	40
	External Corner – Obtuse Angle	8.09	40
	Internal Corner Detail	8.10	40
Junction Details	Framed Soffit	8.11	41
	Inter-Storey Junction with Flashing	8.12	41
	Control Joint – Vertical	8.13	41
	Abutment	8.14	42
	Vertical Gasket and Fixing Detail for Half-bond Panel Layout	8.15	42
Window Details	Typical Commercial Window Installation - Head	8.16	42
	Typical Commercial Window Installation - Sill	8.17	42
	Typical Commercial Window Installation - Jam	8.18	43
	Typical Residential Window Installation - Head	8.19	43
	Typical Residential Window Installation - Sill	8.20	43
	Typical Residential Window Installation - Jam	8.21	43
Parapet Capping	Parapet Capping	8.22	44
Drain	Typical Penetration	8.23	44
Power/Meter Box Details	Typical Power/Meter Box	8.24	44
VENTILATED CAVITY SYSTEM – SEALANT FILLED JOINT DETAILS			
Overview	Sealant Filled Joint Construction – Ventilated Cavity System	8.25	45
Joint Details – Sealant filled	Backing Strip Preparation	8.26	45
	Horizontal Joint – Sealant filled	8.27	45
	Vertical Joint – Sealant filled	8.28	45
Cross Section Details – Sealant filled	Typical System Cross Section for Steel Framing – Joints sealant filled	8.29	46
Head Detail – Sealant filled	Eaves/Deflection Head – Sealant filled	8.30	46
Base Detail – Drained	Base Detail – Drained	8.31	46
Corner Details – Sealant filled	Internal Corner Detail – Sealant filled	8.32	47
	External Corner – Sealant filled	8.33	47

CONSTRUCTION DETAILS



Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

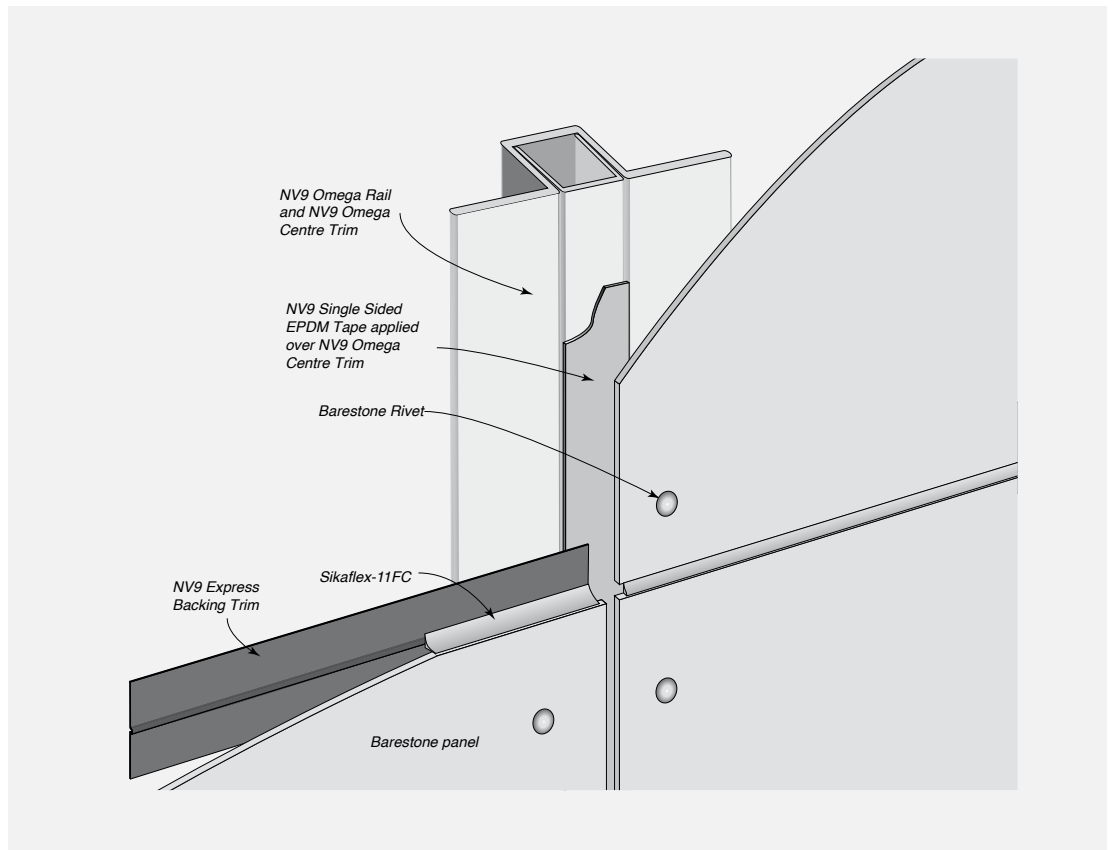Pressure Equalised – Ventilated Cavity System**FIGURE 8.01** Joint Construction - Ventilated Cavity System



CONSTRUCTION DETAILS

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System

FIGURE 8.02 Horizontal Joint – Sealant Filled

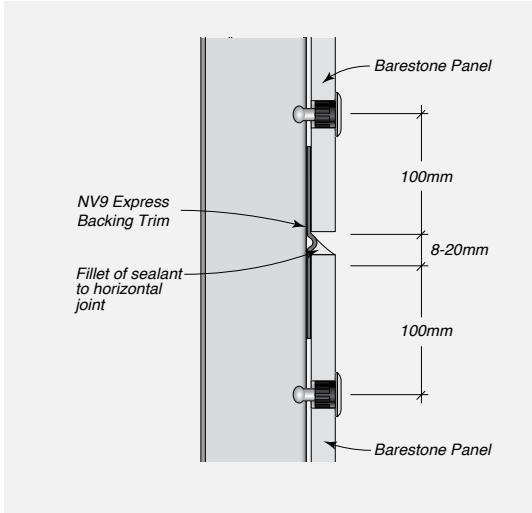


FIGURE 8.03 Horizontal Joint – Angled Backing Strip


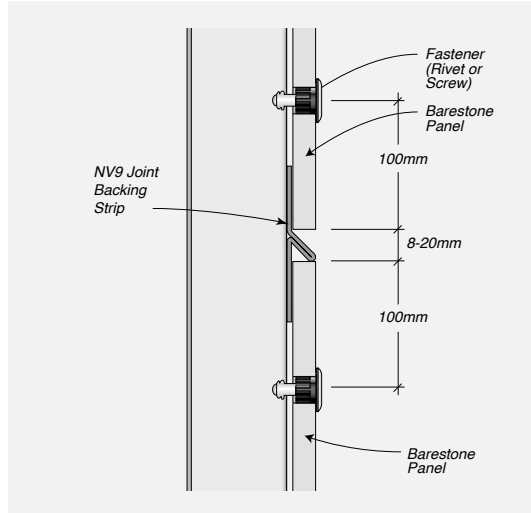


FIGURE 8.04 Vertical Joint – Rivet



CONSTRUCTION DETAILS

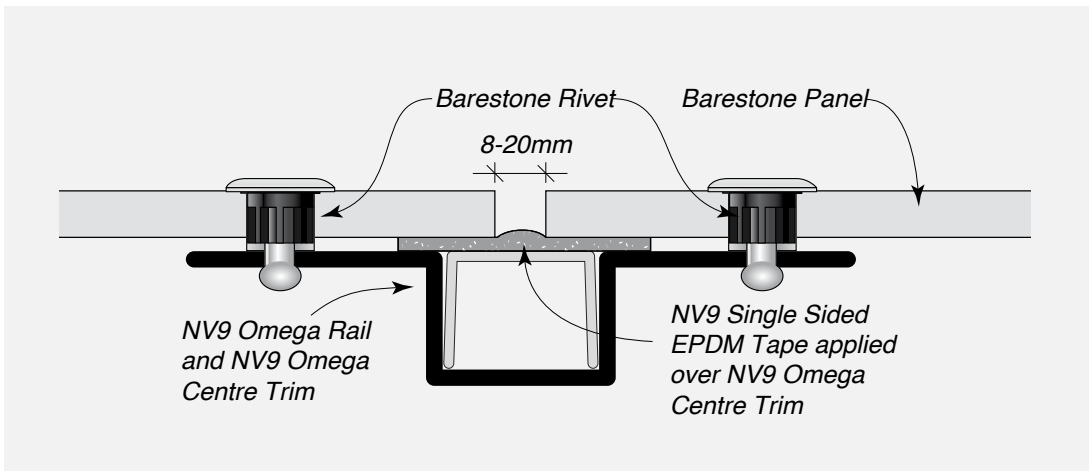

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System

FIGURE 8.05 Typical System Cross Section for Steel Framing

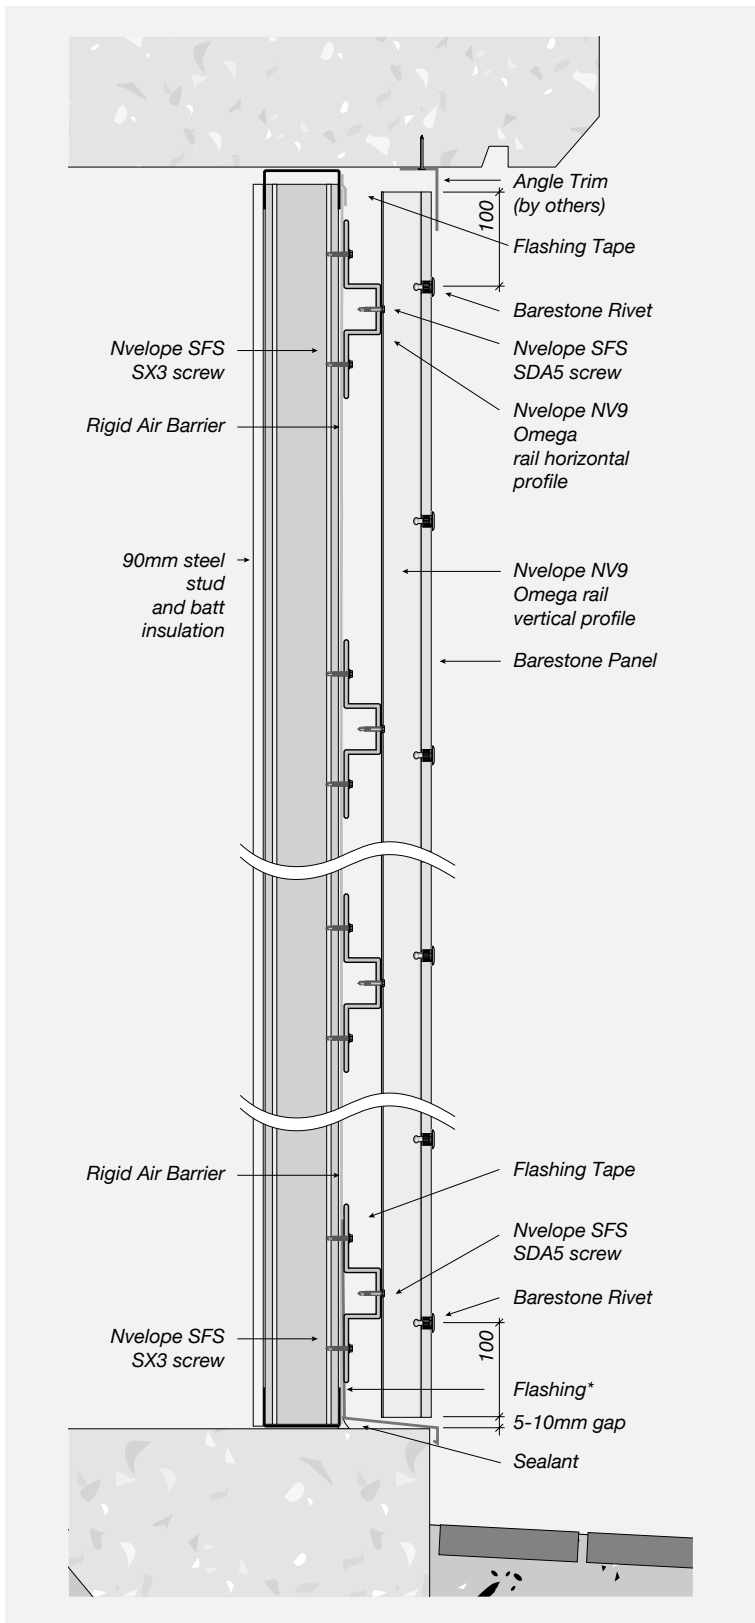


FIGURE 8.06 Eaves/Deflection Head – Ventilated


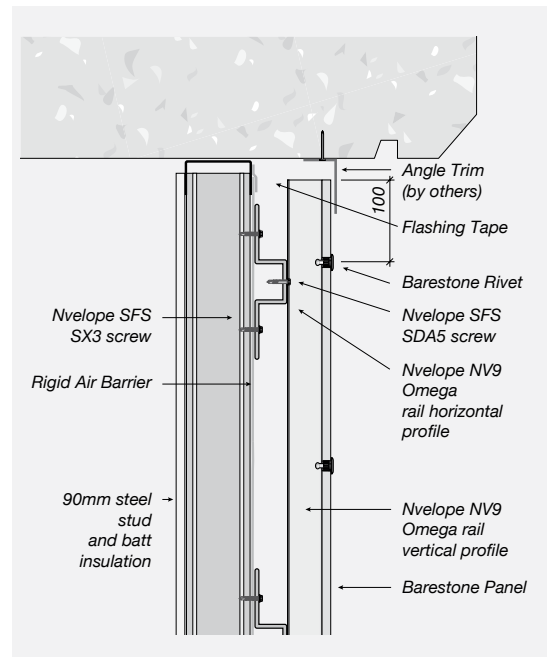


FIGURE 8.07 Base Detail – Drained



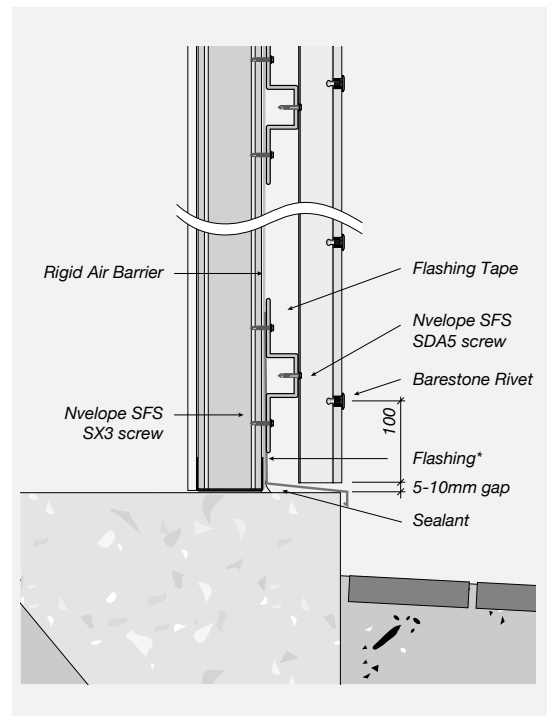

CONSTRUCTION DETAILS

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System

FIGURE 8.08 External Corner

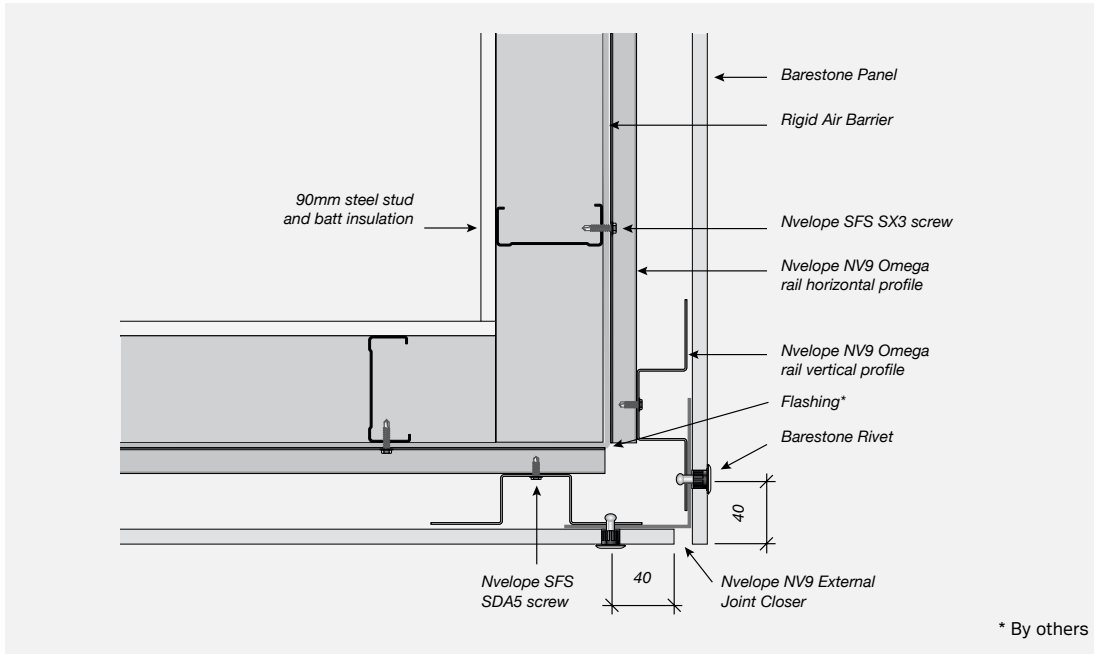


FIGURE 8.09 External Corner – Obtuse Angle


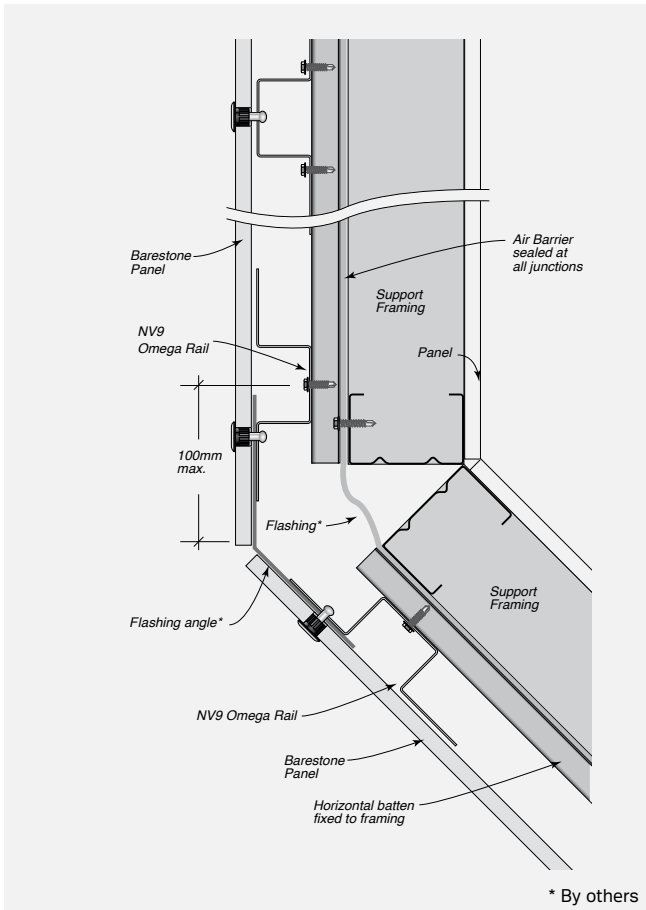


FIGURE 8.10 Internal Corner Detail



CONSTRUCTION DETAILS

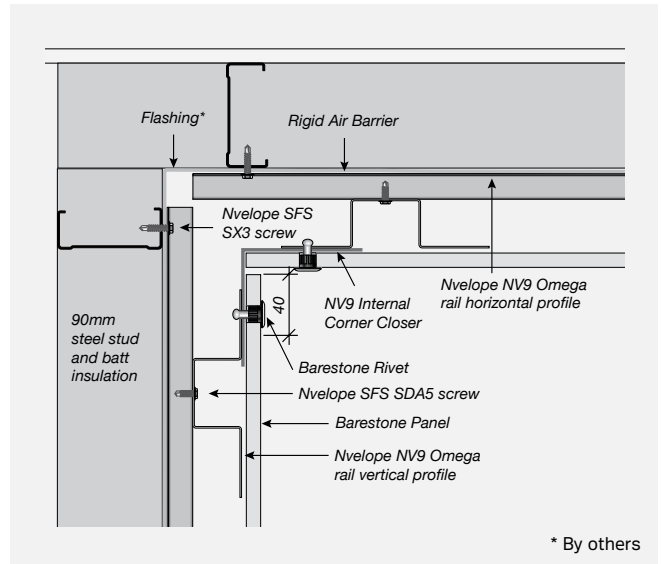

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System

FIGURE 8.11 Framed Soffit

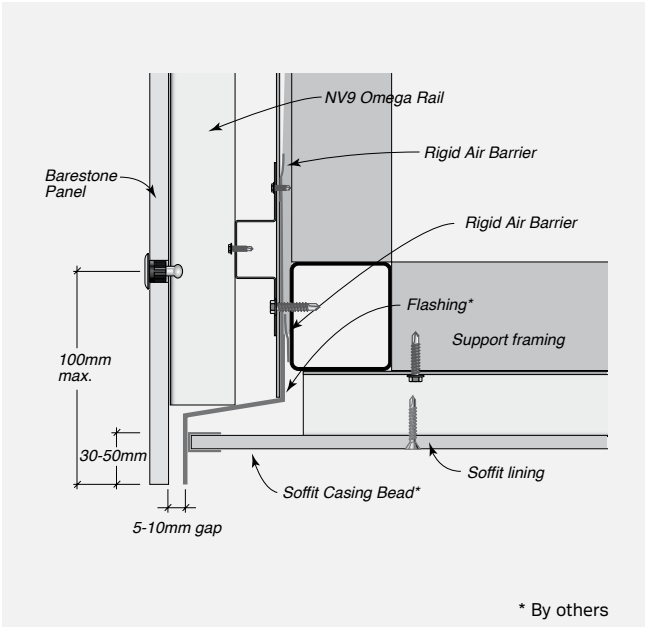


FIGURE 8.13 Control Joint – Vertical


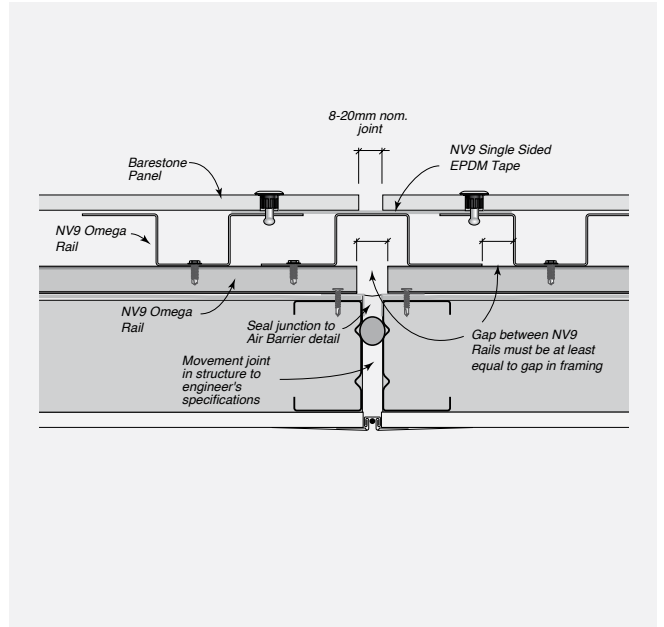


FIGURE 8.12 Inter-Storey Junction with Flashing



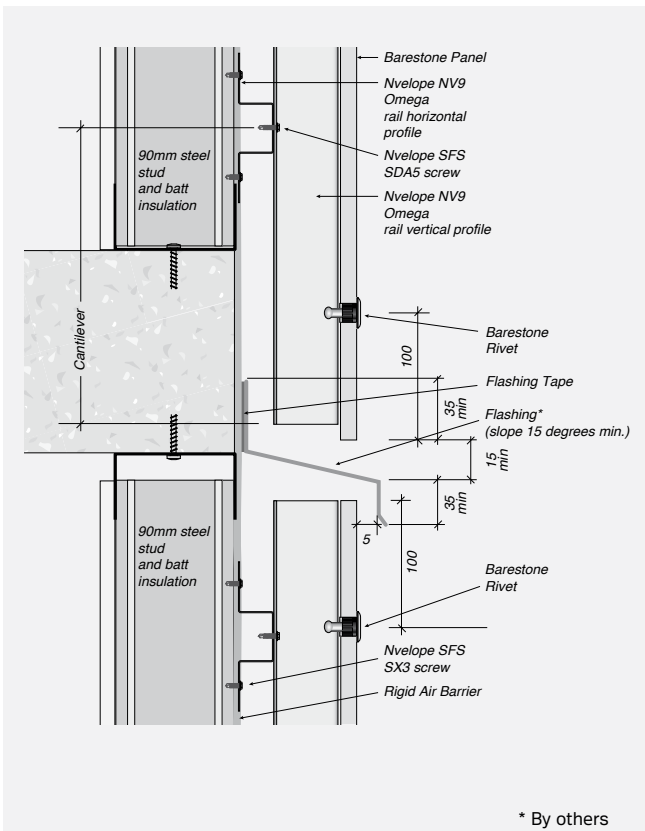

CONSTRUCTION DETAILS

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised - Ventilated Cavity System

FIGURE 8.14 Abutment

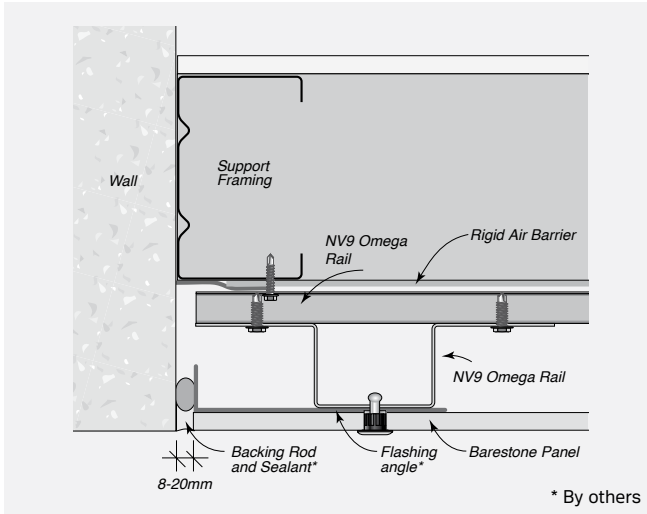


FIGURE 8.15 Vertical Gasket and Fixing Detail for Half-bond Panel Layout

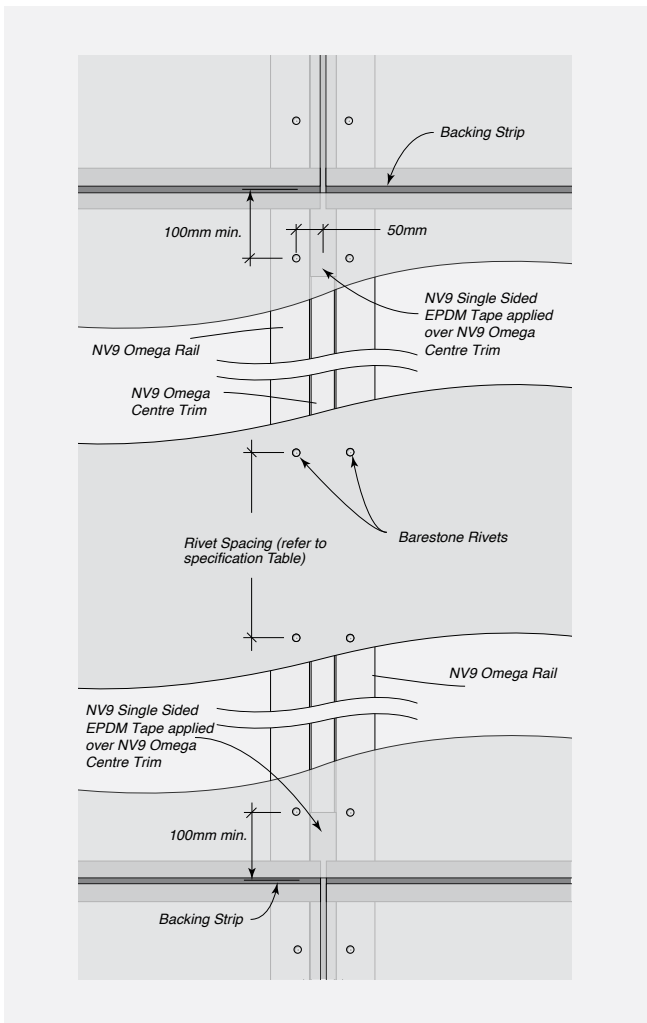


FIGURE 8.16 Typical Commercial Window Installation - Head


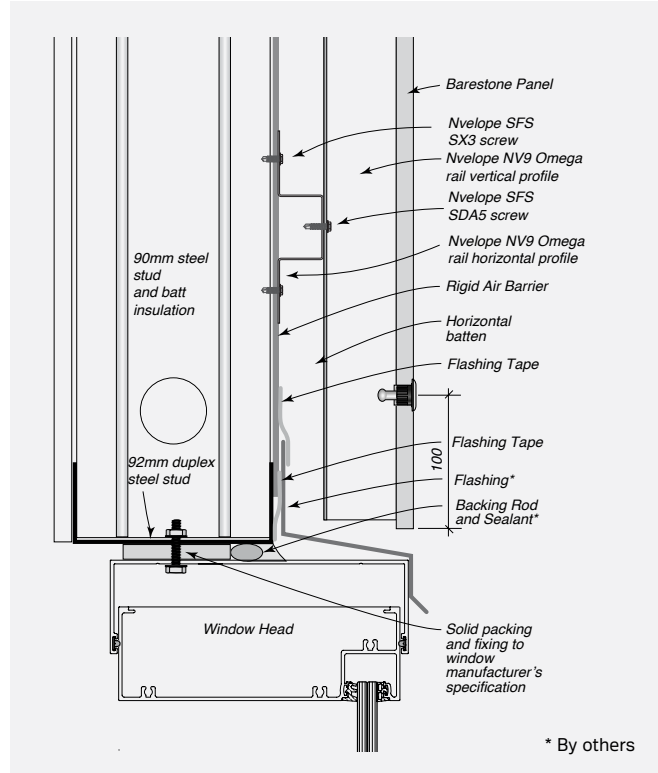


FIGURE 8.17 Typical Commercial Window Installation - Sill



CONSTRUCTION DETAILS

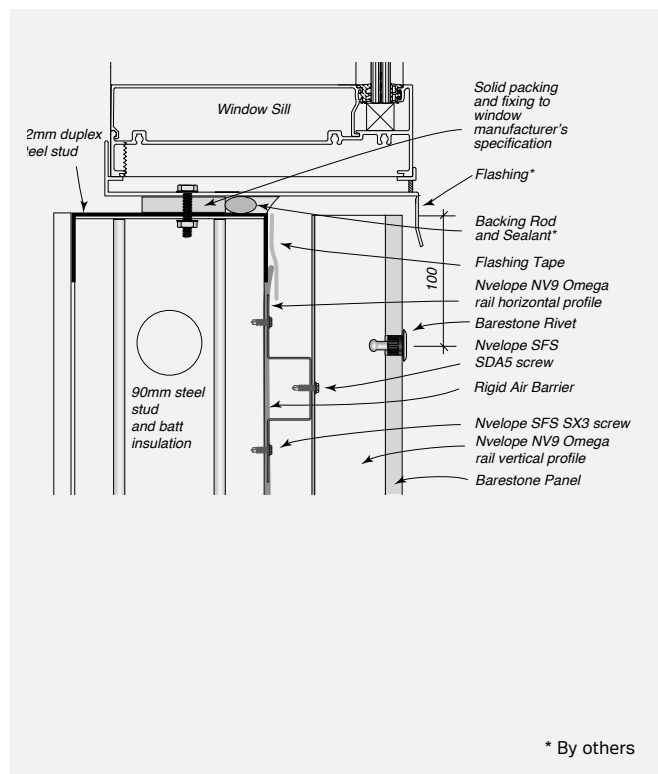

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System

FIGURE 8.18 Typical Commercial Window Installation - Jam

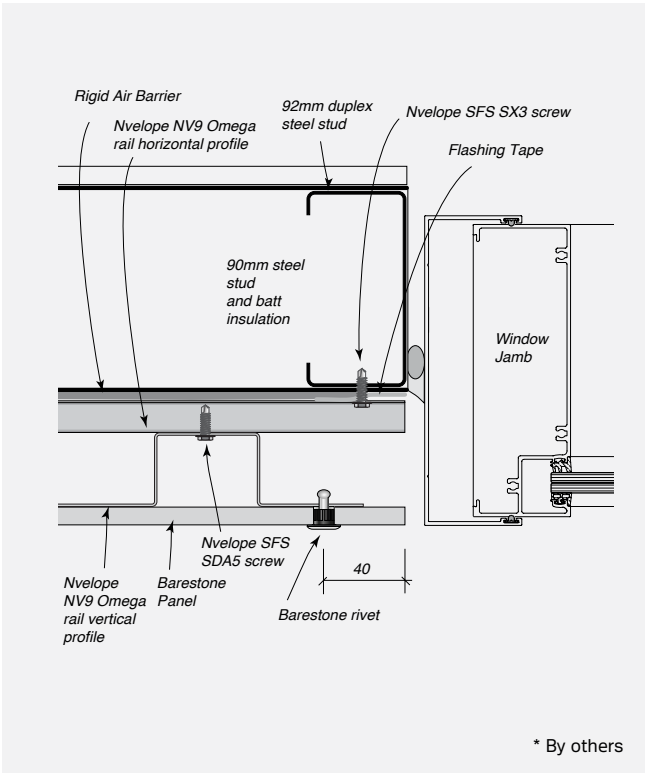


FIGURE 8.20 Typical Residential Window Installation - Sill

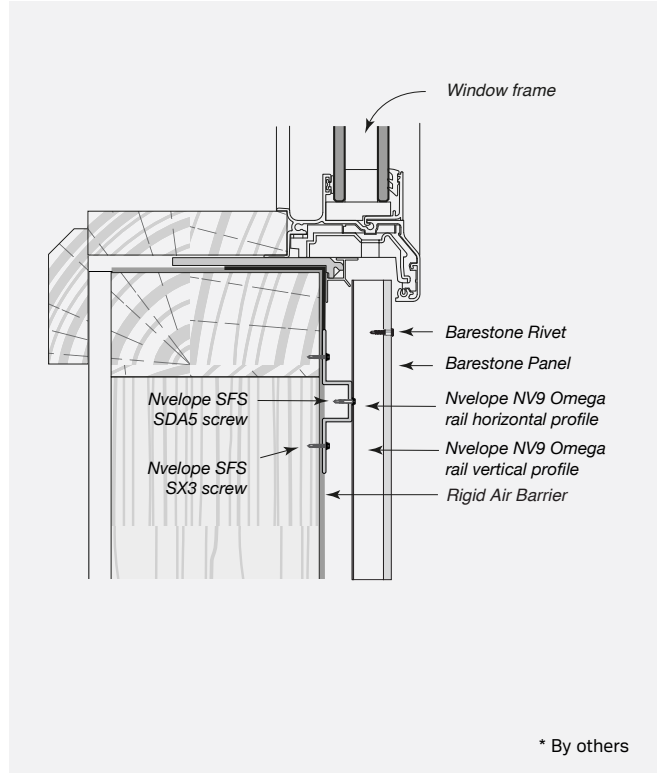


FIGURE 8.19 Typical Residential Window Installation - Head


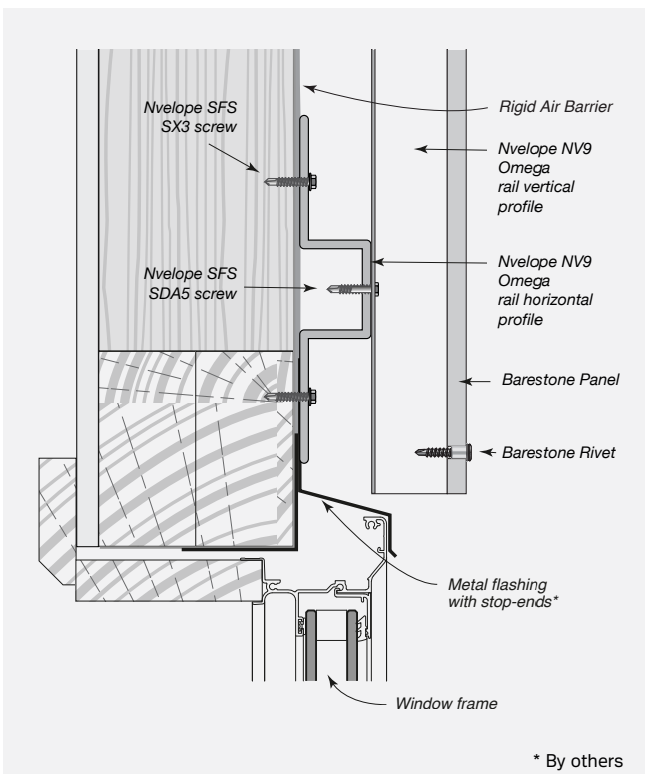


FIGURE 8.21 Typical Residential Window Installation - Jam



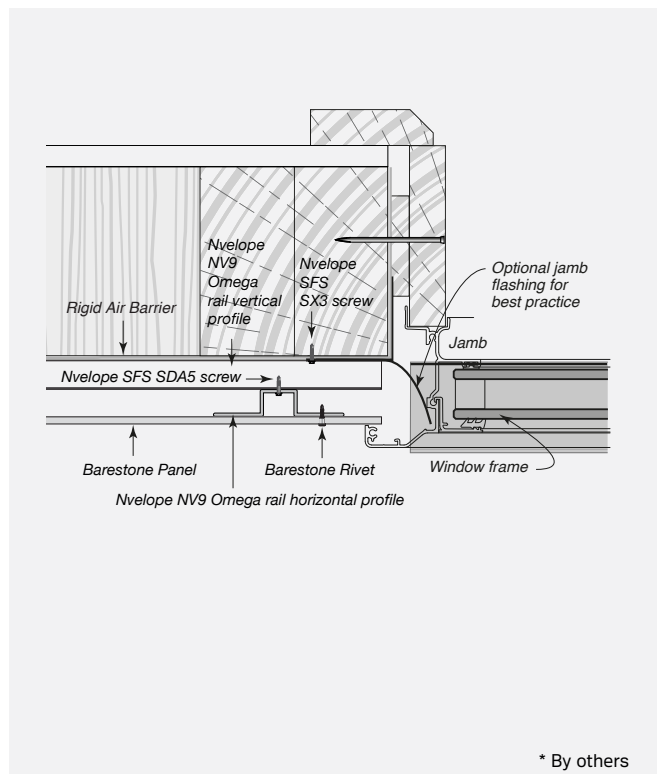

CONSTRUCTION DETAILS

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System

FIGURE 8.22 Parapet Capping

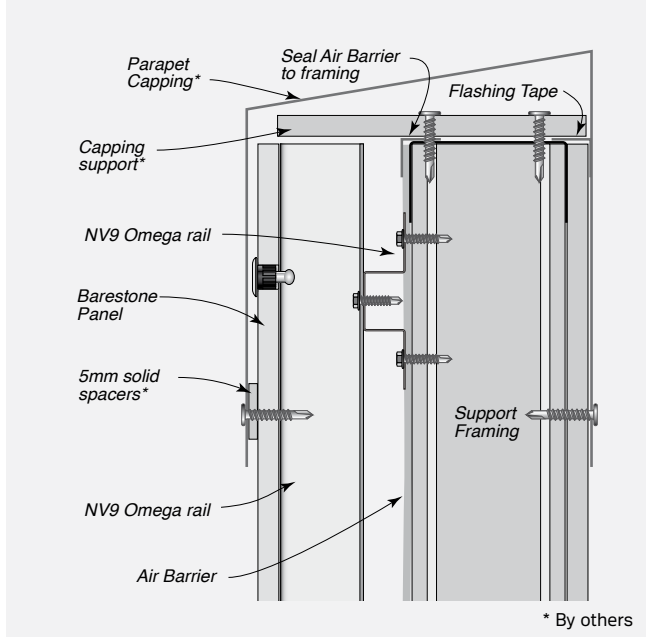


FIGURE 8.23 Typical Penetration


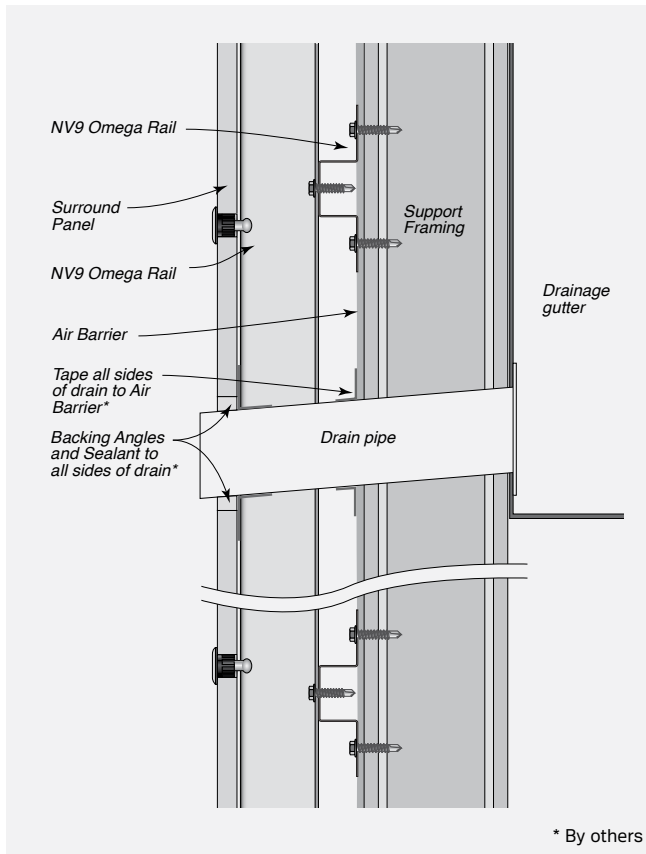


FIGURE 8.24 Typical Power/Meter Box

Note: Refer to local authority for specific meter box installation requirements.



CONSTRUCTION DETAILS

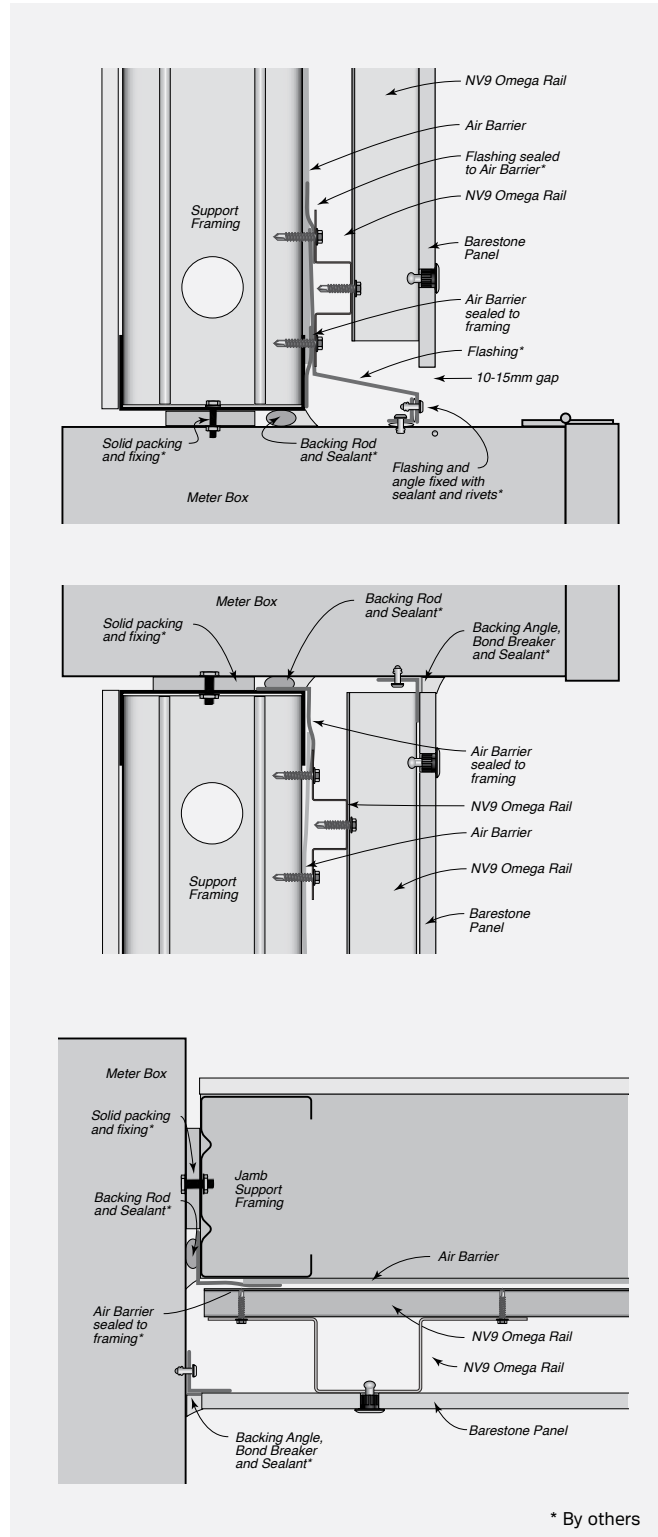

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System – Sealant Filled Joint Details

FIGURE 8.25 Sealant Filled Joint Construction – Ventilated Cavity System

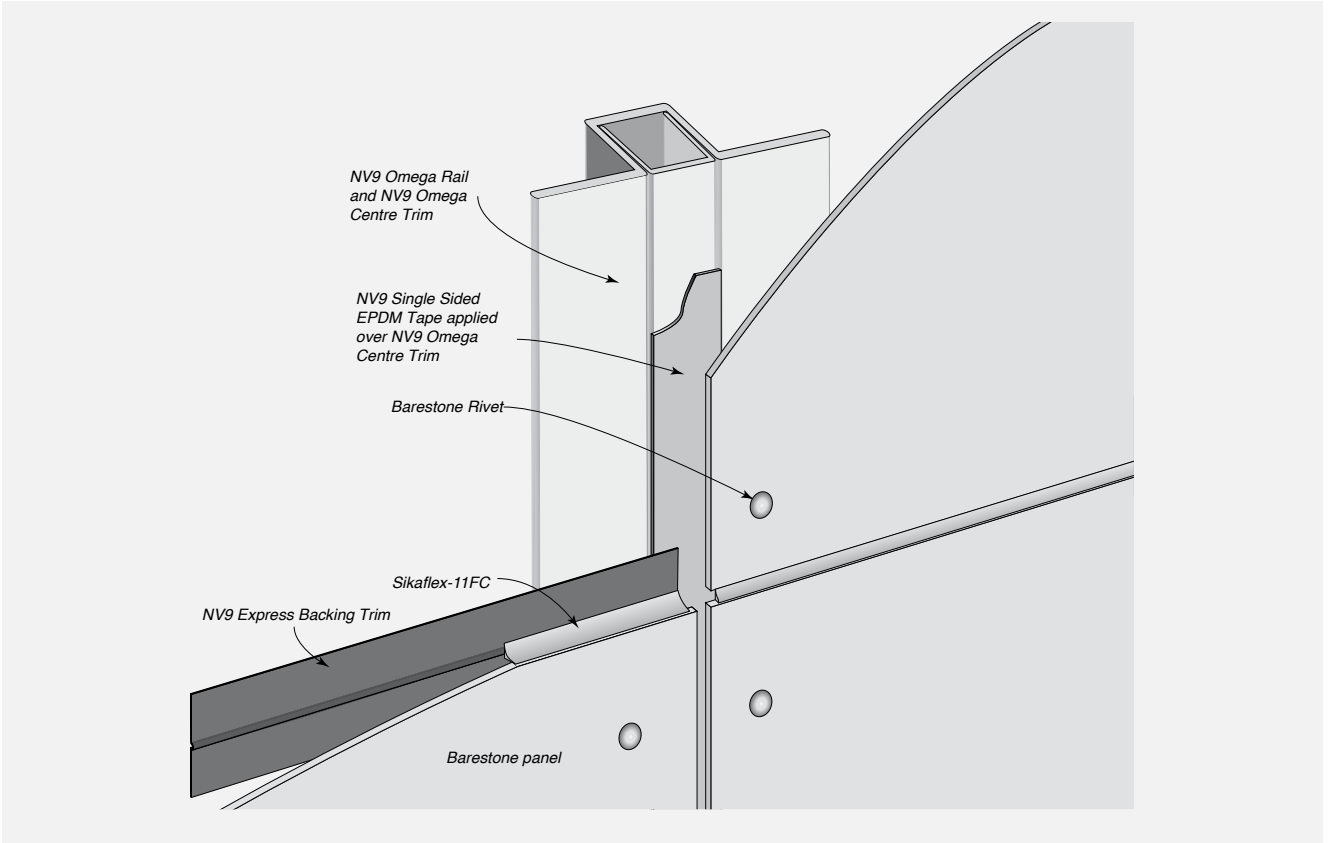


FIGURE 8.26 Backing Strip Preparation

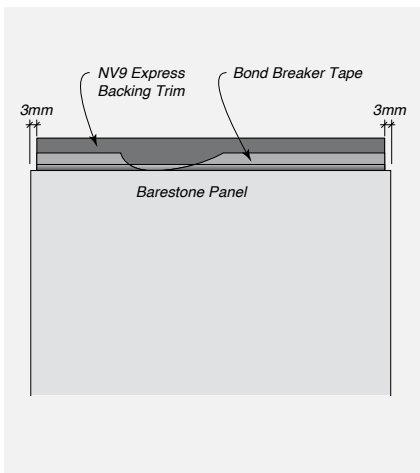


FIGURE 8.27 Horizontal Joint – Sealant filled


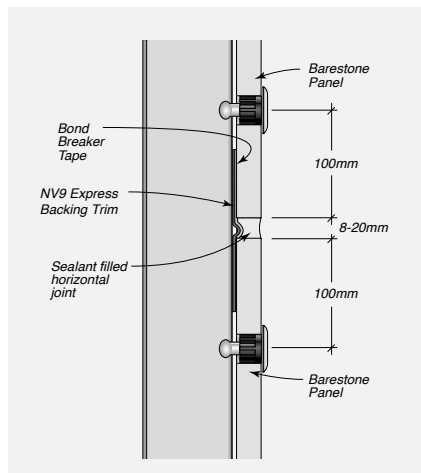


FIGURE 8.28 Vertical Joint – Sealant filled



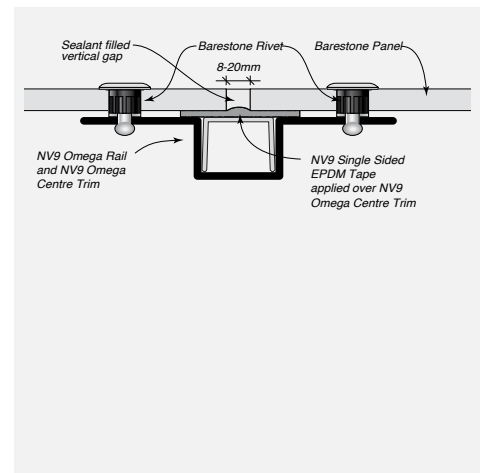

CONSTRUCTION DETAILS

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System – Sealant Filled Joint Details

FIGURE 8.29 Typical System Cross Section for Steel Framing – Joints sealant filled

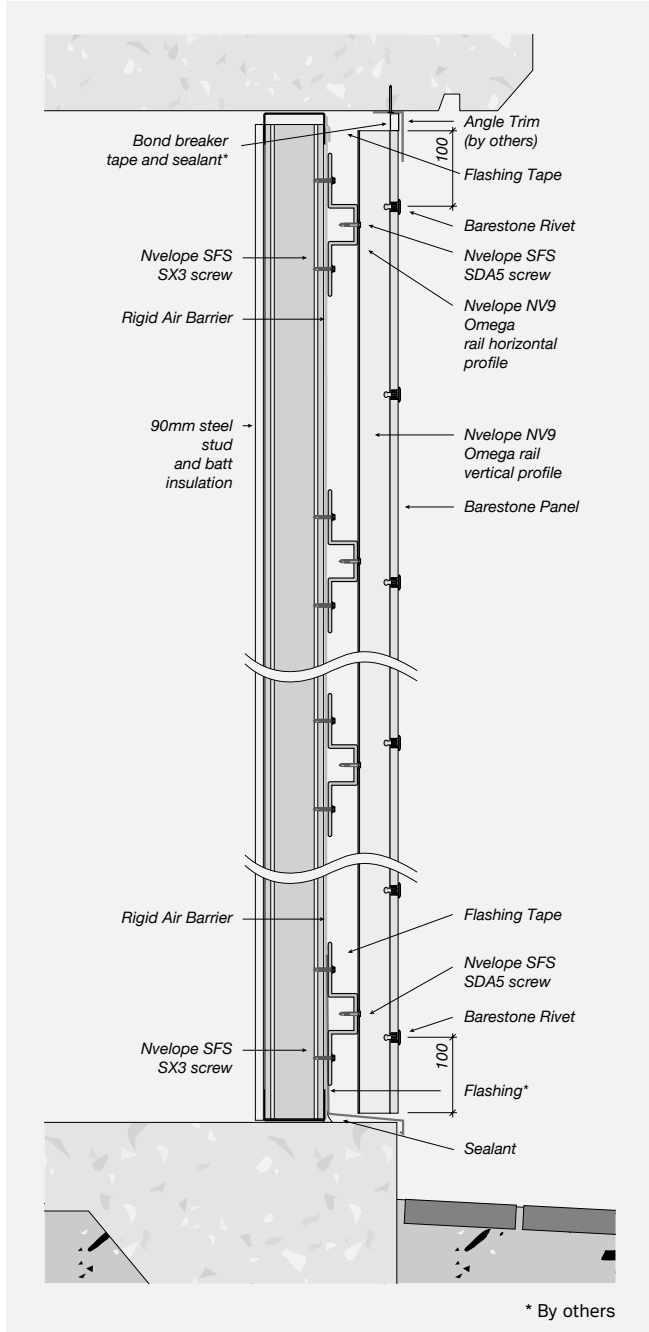


FIGURE 8.30 Eaves/Deflection Head – Sealant filled


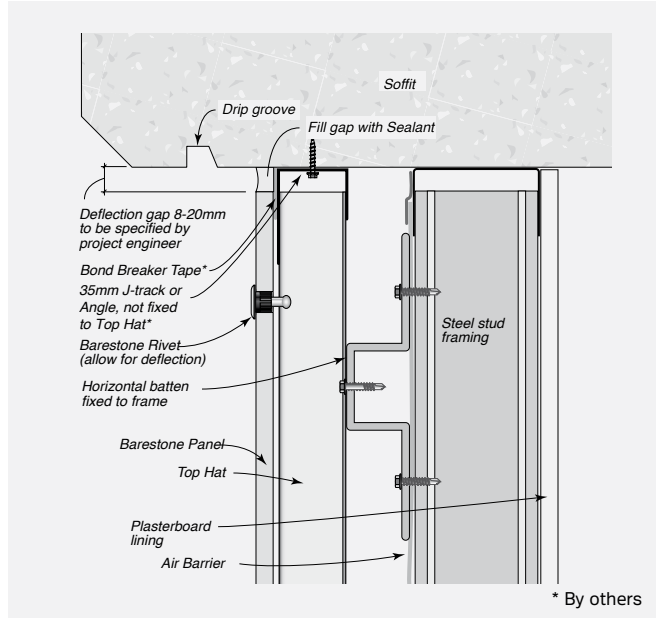


FIGURE 8.31 Base Detail – Drained



CONSTRUCTION DETAILS

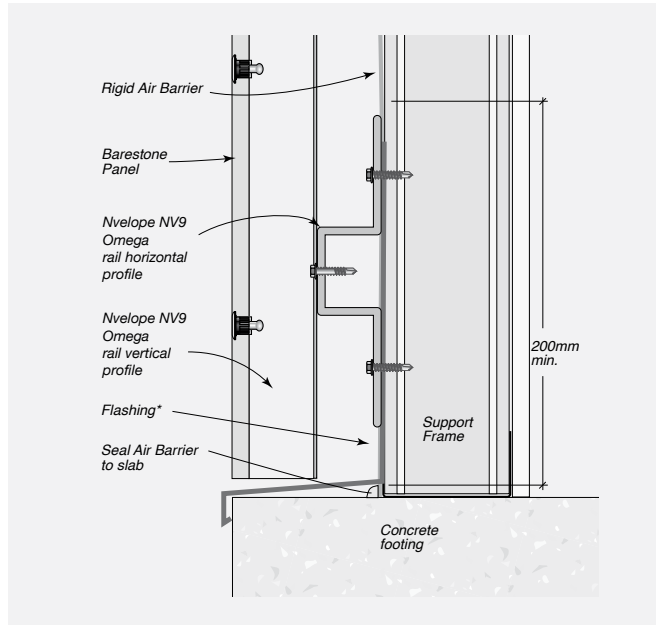

Note: Drawings are interchangeable for timber or steel substrates with the exception of the fasteners.

Pressure Equalised – Ventilated Cavity System – Sealant Filled Joint Details

FIGURE 8.32 Internal Corner Detail – Sealant filled


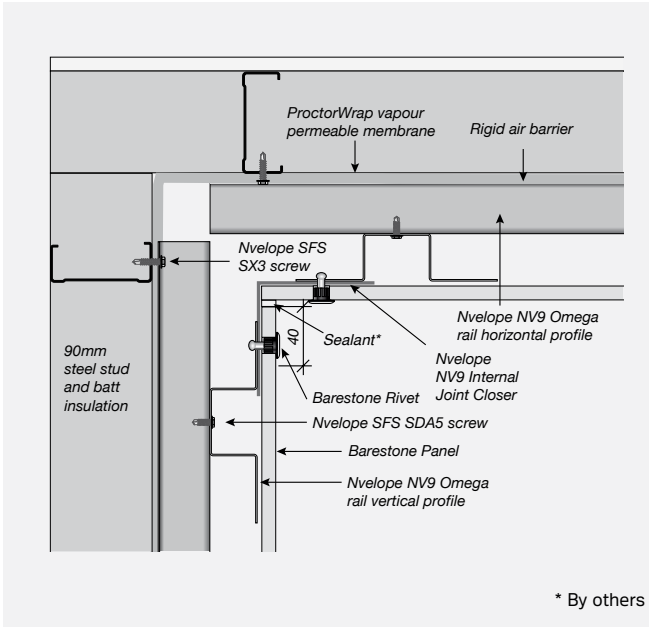


FIGURE 8.33 External Corner – Sealant filled



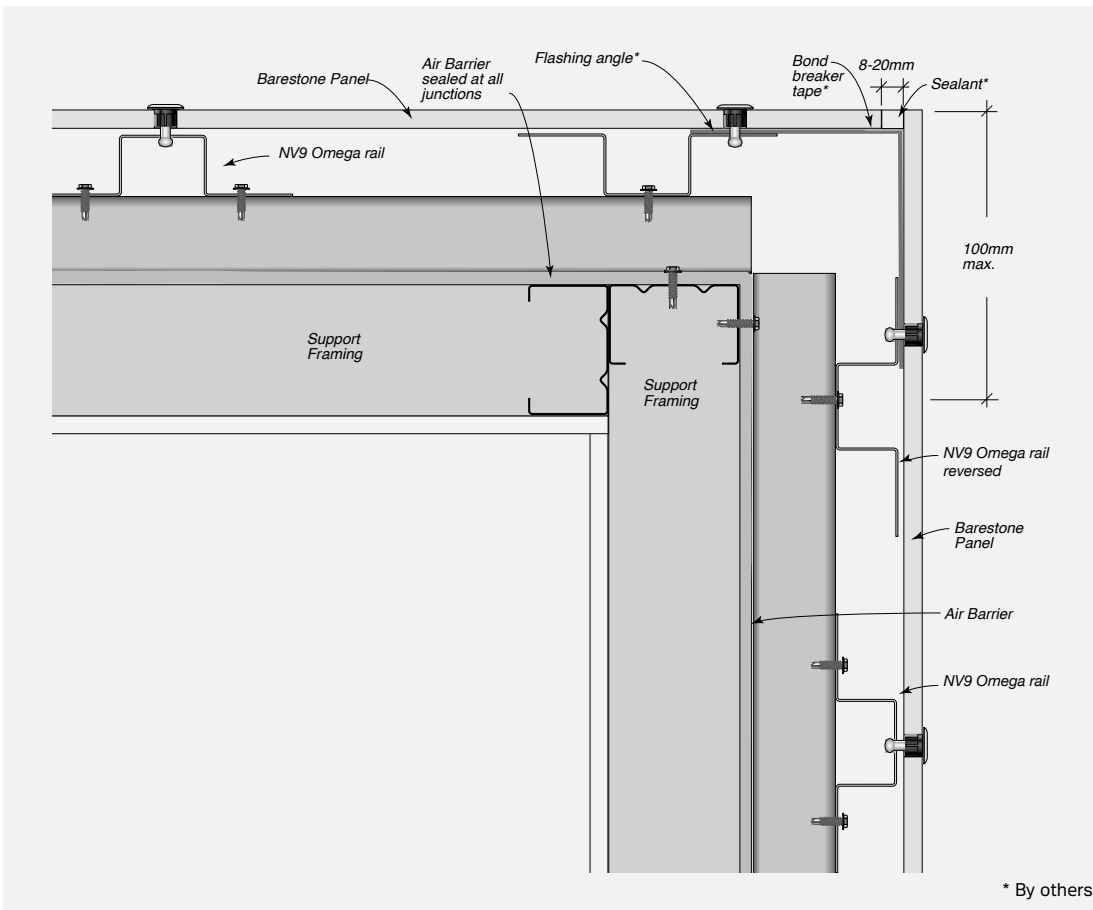

**SAFETY, HANDLING
+ GENERAL CARE**

SAFETY, HANDLING + GENERAL CARE




Health, Safety and Personal Protection Equipment (PPE)

Panels contain silicas that are harmful if inhaled. Protective clothing and breathing equipment must be worn when cutting products.

When cutting, drilling or grinding Barestone panels using power tools, always ensure the work area is properly ventilated. An approved dust mask (AS/NZS

1715 and AS/NZS 1716) and safety glass (AS/NZS 1337) must be worn. Cemintel recommends that hearing protection also be worn.

Safety Data Sheet information is available at stateofclad.co.nz



Recommended Safe Working Practices

Cutting Outdoors	<ol style="list-style-type: none"> 1. Position cutting station so wind will blow dust away from the user or others in the working area. 2. Use a dust reducing plunge saw equipped with a dust extraction system.
Sanding/Drilling/Other Machining	When sanding, drilling or machining, you should always wear a P1 or P2 dust mask and warn others in the immediate area.
Important Reminders	<ol style="list-style-type: none"> 1. NEVER use a power saw indoors. 2. NEVER use a saw blade that is not purpose-made for cutting fibre cement products. 3. NEVER dry sweep. 4. ALWAYS follow tool manufacturers' safety recommendations. 5. ALWAYS maintain tools in a clean condition.

Handling & General Care

Storage

All Barestone panels must be stacked flat, clear of the ground and supported at 300mm maximum centres on a level platform. Panels must be kept dry, preferably stored inside the building. Panels must be dry prior to fixing, hence if it is necessary to store outside, the product must be protected from the weather.

Handling

Barestone panels are prefinished products and must be treated with care during handling so as to avoid damage to edges, ends and prefinished surface. Panels should be carried horizontally on edge by at least two people.

As Barestone external is a prefinished product, consideration should be given to the activity of other tradespeople. It is highly recommended that installation of Barestone should always be held off until the process of installing all other cladding has been completed so as to avoid damage.

Cutting

Panels should be cut from the back using a power saw. Cemintel recommends using the Makita Plunge Cut Saw with guide rail and appropriate blade, together with the appropriate dust extraction system.

All exposed cut edges **MUST BE SEALED TO PREVENT MOISTURE ABSORPTION**. Refer to 'Components' table for appropriate materials.

Mitres

It is not recommended to mitre panels as this can cause delamination of the face.

Penetrations

Penetrations in panels may be cut or drilled prior to installation. Cut from the back or drill from the front. Cut penetrations oversize by 8-10mm all around. Mask, prime and fill gaps with sealant in accordance with recommended methods and products.

Bevelled Edges

The top edge of panels at window sill level may require bevelling.

10
WARRANTY, CLEANING
+ MAINTENANCE

Warranty

The Cemintel Barestone External panels have a product warranty of 15 years.

The full product warranty is available for download at stateofclad.co.nz

Wash Down Process

Panels have been coated with a factory finish. Consequently, where sufficiently exposed, rain can perform a natural wash down of the wall and ongoing maintenance should be limited to occasional rinse down or using a soft cloth or soft brush (like a dust pan brush).

Walls which are protected by soffits above must be washed down twice per year to remove salt and debris build up particularly at joints.

When cleaning the panels the following is recommended –

- Normal dirt can be removed with a soft brush and warm water up to 50 degrees celsius, to which a small amount of dishwashing liquid or soap has been added. The panels should be rinsed with clear water before they dry.
- Calcifications should be removed with a 5% sulfamic acid solution or with a commercial lime remover. The façade should be rinsed with clear water after cleaning.
- Panels discoloured by algal growth should be treated with an algicide without bleaching agents. This application should be allowed to take effect for several days. Afterwards, clean the panels using the 'normal dirt' procedure above.
- When rinsing down panels, use no more than 700 psi (50kh/cm²) of water pressure at a minimum of 3m distance from the face of the wall. Water pressure should be applied downward to avoid forcing water into joints.
- Use neutral detergent with a soft cloth or soft brush when removing dirty spots from a panel. When diluting the neutral detergent, follow the manufacturer's instructions and use the weakest solution possible.

Inspection, Repair and Maintenance

The durability of the Cemintel Barestone range can be enhanced by periodic inspection and maintenance. Inspections should include examination of the coatings, flashings and seals. Any cracked or damaged finish or seals which would allow water ingress must be repaired immediately by resealing the affected area, or by removing the panel and replacing sealant. Any damaged flashings, sheets or sealant must be replaced as for new work.

Regularly inspect panel surfaces and follow wash-down procedures when required.

Ensure ventilation and drainage gaps between panels and flashings are clear of any debris.

It is recommended storing additional panels in case any panels are damaged in the future.



Cemintel Barestone distributed exclusively in New Zealand by State of Clad

STATE OF CLAD

Our Offices

Auckland

956 Great South Road
Penrose, Auckland

Hamilton

59 Vickery Street
Te Rapa, Hamilton

Tauranga

15 Hynds Road
Greerton, Tauranga

Christchurch

1/99 Sawyers Arms Road
Papanui, Christchurch

stateofclad.co.nz
0800 274 257

For Design and Technical Support:
0800 667 887

Disclaimer: Information presented in this document is supplied in good faith and to the best of our knowledge, was accurate at the time of preparation. Products are subject to natural variation as part of the manufacturing process. Product images may vary from actual product in regard to colour and surface finish. The provision of this information should not be construed as a recommendation to use any of our products in violation of any patent rights or in breach of any statute or regulation. Users are advised to make their own determination as to the suitability of this information in relation to their particular purpose or specific circumstances. Since the information contained in this document may be applied under conditions beyond our control, no responsibility can be accepted by State of Clad, or its staff for any loss or damage caused by any person acting or refraining from action as a result of misuse of this information.